



HAL
open science

Description induced by modelisation methods in the case of building thermal simulation

Harry Boyer, François Garde, Philippe Lauret, Jean Brau

► **To cite this version:**

Harry Boyer, François Garde, Philippe Lauret, Jean Brau. Description induced by modelisation methods in the case of building thermal simulation. International Building Performance Simulation Association, IBPSA 1995, Aug 1995, Madison, United States. pp.64-70. hal-00768560

HAL Id: hal-00768560

<https://hal.science/hal-00768560>

Submitted on 21 Dec 2012

HAL is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

DESCRIPTION INDUCED BY MODELISATION METHODS IN THE CASE OF BUILDING THERMAL SIMULATION

Harry BOYER, François GARDE, Alfred LAURET

Université de la Réunion, Faculté des Sciences
Laboratoire de Génie Industriel, 15 rue René Cassin
97705 Saint-Denis Cedex. Ile de la Réunion- FRANCE
E. mail : boyer@helios.univ-reunion.fr

Jean BRAU

INSA de Lyon
C.E.T.H.I.L., E.E.H., Bât 307
20 rue Albert Einstein
69621 Villeurbanne Cedex (FRANCE)

ABSTRACT

Two main modelisation techniques are the analytic and systemic methods. After a presentation of each method applied to building simulation, this paper emphasizes the benefit of systemic modelisation for multizone cases. Using a conceptual description of a building issued of previous method, one particular sub-system appears naturally, i.e. the thermal zone. Then, the physical coupling of thermal zones can simply be solved. Building description through data structures, required for thermal simulation, is easily reached. The detail of our organisation is given in the case of our multiple model software, *CODYRUN*. Because of our resolution scheme, the main problem is the establishment of a thermal zone model. So, the computer generation of one zone nodal model is explained.

INTRODUCTION

At the beginning of this work, our objective was to realize a design tool suitable for professionals and usable by researchers. More precisely, *CODYRUN* is a multizone software integrating both natural ventilation and moisture transfers. During a simulation, one of its most interesting aspects is to offer the expert thermician a wide range of choices between different heat transfer models and meteorological reconstitution parameters models. The aim may be to realize studies of the software sensitivity to these different models, in order to choose those that should be integrated in a suitable conception tool. It was developed on a PC micro computer with *Microsoft WINDOWS* user-friendliness interface.

Considering the thermal behaviour of a building, its thermal state is determined by the continuous field of temperatures, concerning all points of the physical limits of the building. The constitution of a reduced model is possible by assuming some simplifications, as mono-dimensional conduction in walls or well mixed air volumes of each thermal zone. In this case, zones and wall temperatures are the main unknown variables of the problem.

ANALYTIC METHOD APPLIED TO THERMAL BUILDING SIMULATION

As in other fields, computer simulations and before modelisation methods became key words. History of modelisation shows the domination of the analytic method. This procedure means that it's possible to reduce the studied object into elementary parts and that it's possible to build a model of the object from these parts. So, the building system is considered as split up into simple systems, like walls, windows, air volumes, HVAC systems, and so on. Then, it's necessary to study them one by one and to understand the existing interactions. To apply this method to heat transfer in buildings, we'll consider an important component of a building, a wall. The thermal field expresses the instanted balance between conduction, convection and radiation heat transfers. For each of these phenomena, analytic models are available and their assembly will build a wall thermal model. For conduction transfers, inputs for each side of the wall (indiced respectively by 1 and 2) are ϕ_{CV} (convective flux), ϕ_{SW} (short wave flux) and ϕ_{LW} (long wave). The outputs of the model are temperatures inside the wall, $\{T_i\}$, and surface temperatures T_{s1} and T_{s2} .

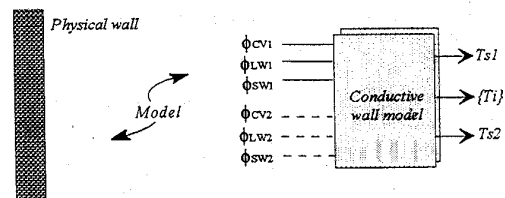


Fig. 1 : Conduction model for a wall

Concerning convection heat transfer, we choose a simple model considering surfaces and air temperatures (respectively T_s and T_d), illustrated by figure 2.

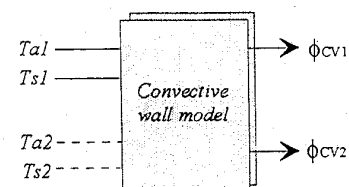


Fig. 2 : Convection model for a wall

Relations between the three levels of description (i.e. lines on the previous figure) exprimate belonging relations. So, if one room is considered as a thermal zone, we can say that the room belongs to the building. If this room is air conditioned, the HVAC system belongs to the zone. As given our definition of a thermal zone, a component may belong to two zones (bolded lines). Such a component (separation wall or opening) is performing the thermal coupling of the separated zones. To make the description easier, we prefer to introduce another object, the *Inter-zone*, to which the coupling components belong.

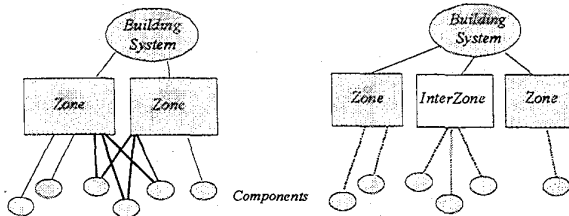


Fig. 8 : Systemic and conceptual building description

CODYRUN BUILDING DESCRIPTION

The first purpose of our work has been to allow - as far as heat transfer modes, airflow calculation and meteorological data reconstitution are concerned- the integration of diverse interchangeable physical models in a single software tool for professional use, *CODYRUN*. The designer's objectives, precision requested and calculation time consideration, leads us to design a structure accepting selective use of models [Boyer 93], taking into account multizone description and airflow patterns. Concerning thermal aspects, the matricial model constitution looks like ESP [Clarke 85] and airflow model can be compared to AIRNET [Walton 84]. A main difference is our objective of professional use, involving a user-friendly interface.

The three main parts of *CODYRUN* are the building description, the simulation program and the operation of the results. As far as the description is concerned, we have been brought to break down the building into three types of entities which are the following ones : firstly, the *Zones* (from a thermal point of view), the *Inter-zones* partitions (zones separations, outdoor being considered as a particular zone) and finally, the *Components* (i.e. walls, glass partitions, air conditioning system sets, ...). The following tree-like structure illustrates our organisation :




Fig. 9 : Data organization

Then, the user's interface proposes to begin the description of a building with the following window :

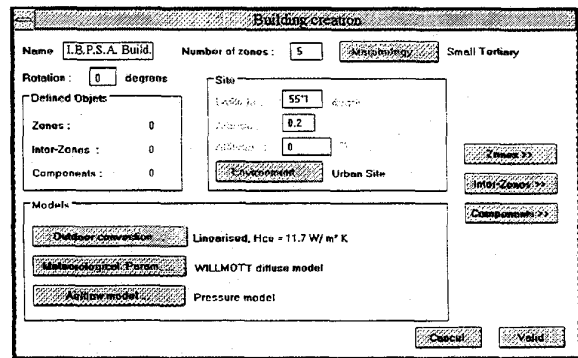


Fig. 10 : Building description window

A few information fields are associated to the building, as name and morphology, or its location (latitude, environment, ...). The border titled *Defined objets* remembers the number of zones, interzones and components previously attached to the building. The number of zones, informed during building creation, is a data that won't be modifiable. The choice we made was to condition the building description by the number of zones. The push buttons zone, interzone and components make possible the access to this previously defined entities. The access to the models linked to the entity "building" is also possible from this window through the push buttons of the screen part called "models". It is possible in this way to select the chosen models for outside heat convection transfer, reconstitution of meteorological parameters (diffuse and sky temperature) as well as the airflow model.

The second presented window is concerning the thermal zone entity. The main associated datas are a name (that will be needed later to affect components to this zone or for interzone location) and the volume. The push buttons < and > allow access to the window concerning respectively the previous and next zone.

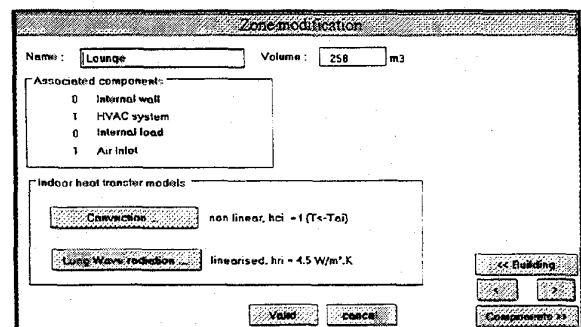


Fig. 11 : Zone description window

After filling building and zones windows, it's necessary to give informations about Interzones. The name will be used to affect components. Each Interzone has a type, listed in the border tilted *Type*.

This information is needed by models (for an opening affected to an interzone, the airflow model needs to know if the interzone is vertical or horizontal) or in order to control components affectation (for ex., no wall on slab in a vertical indoor interzone).

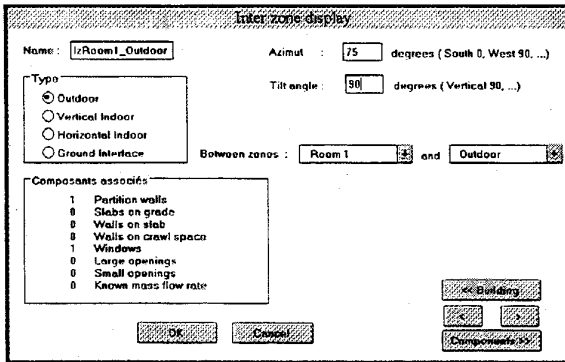


Fig. 12 : Interzone description window

The description now corresponds to a building squeleton. To complete the building, the following board lists the components already integrated :

Zone components	Interzone components
internal wall	partition wall
HVAC system	slab on grade
internal load	wall on slab
air inlet	wall on crawl space
	window
	large opening
	small opening
	known air flow rate

For all the components, name, type (among the proposed component types), and name of the entity (zone or interzone) it belongs to is to be indicated. The following figure is corresponding to an HVAC system, attached to a zone (by using the list box containing the names of the zones).

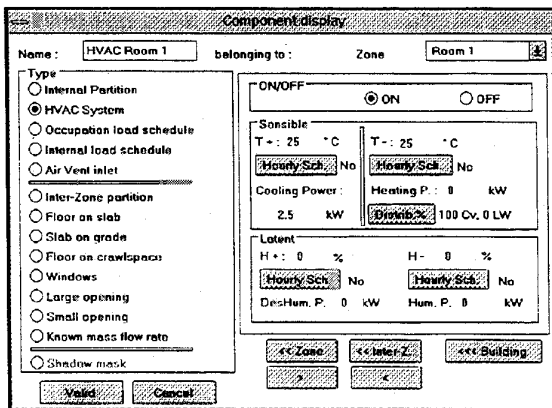


Fig. 13 : HVAC system description window

The components being of different types, specific information is needed for each component.

Thus, for an air conditioning system, information relative to the sensible and latent loads are to be entered. We must then define the threshold temperature values (high and low), the hourly schedules and the available heating and cooling powers. Most of the time, simulation softwares consider the heating power as convective. However, to allow a better integration of systems such as heating floors, it is possible to choose for the involved power convective and radiative ratios. Another example of component window is concerning a partition wall.

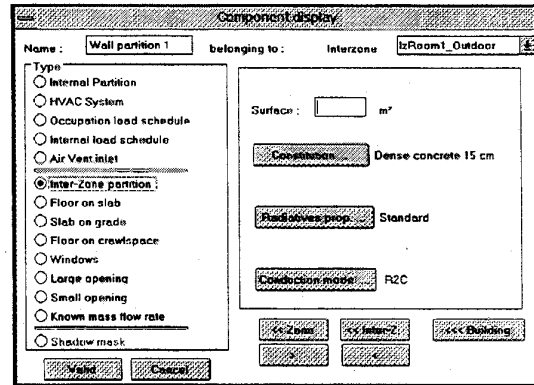


Fig. 14 : Wall description window

For such a component attached to an interzone, surface has to be entered, as constitution, radiative properties and conduction model. For these three last groups of information, default values are assumed (and mentioned). Action on the corresponding push-button give access to other windows allowing to change these default values.

FROM DESCRIPTION TO BUILDING MATHEMATICAL MODEL

As proposed by systemic analysis, we'll focus on one zone model constitution. With the usual physical assumptions, we use the technique of nodal discretisation ([Chapman 84], [Saulnier 85]) of the space variable by finite difference. In addition, the mass of air inside one zone is represented by a single thermal capacity. Thus, for a given zone, we'll consider the principle of energy conservation applied to each concerned wall and glass-window node. Then, associated with the sensible balance of the inside air volume and the radiative balance equation of inside radiant mean temperature, this set of equations constitutes the zone thermal model, that can be condensed in a matricial form :

$$[C] \left\{ \frac{dT}{dt} \right\} = [A] \{T\} + \{B\}$$

In the previous equation, {T} is the vector of all the nodes of the zone and [C] is a diagonal matrix concerning their thermal capacities. [A] contains all

the terms corresponding to energy exchanges in the considered zone and B contains solicitations. Then, to build a multizone model, we consider the thermal coupling of sub-system zones (each having a matricial model), we solve each zone separately and assume temperatures convergence. The figure 10 shows the way of coupling two zones (1 and 2), their intersection constituting the Inter-zone [Blanc Sommereux 1980].

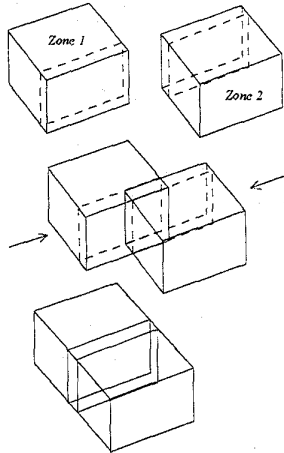


Fig. 15 : Thermal coupling of two zones

A given building is composed with a certain number of rooms, walls or also glass windows. From this variable description, the building splitting-up into a certain number of zones is a simulation parameter. Taking into account our scheme of iterative coupling between zones, our principal problem is one of the establishing of the state evolution equation of each zone, illustrated by next figure in the case of a two zones building.

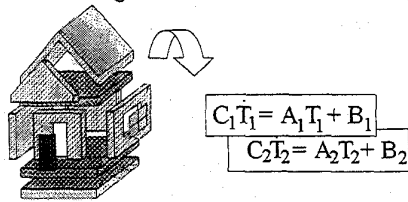


Fig. 16 : From building description zones models

To fill up each of those mathematical objets (i.e. C, A et B), from the description files of the building (walls, glass windows, ...), we build a data structure constituted of information fields attached to each discretisation node. An incremental number is attached to each node, to index our structure. The building description bringing in a certain number of walls and glass-windows, knowing the number of nodes constituting the discretisation of each entity, all the walls and glass-windows nodes can be numbered. Therefore, the building splitting up into thermal zones induces the setting of two nodes of temperature by zone (dry air and mean radiant temperature). The following figure explains our proceeding.

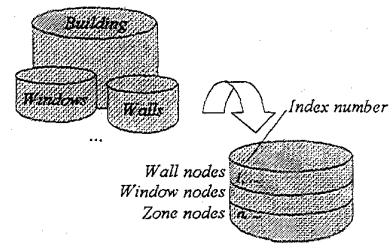


Fig. 17 : The nodal structure generation

A certain number of information fields are connected to a node, traducing for instance the appartenance of a node to a zone or also the topology of the global electrical network associated to the building. Considering the objective to be reached, we have been induced to impute a type to each node. Indeed, relatively to the equations, the nodes are concerned by different phenomenons. For instance, a wall node is going to concern terms of heat conduction. This same node, depending on its disposal, can also concern convective process. The board below gives in its first column the encountered types of nodes and in the second one a reference number that we'll find again on the next figure.

Type	Ref. number
Outdoor surfacic node of outside wall	1
Indoor surfacic node of outside wall	2
Internal node of outside wall	3
Outdoor surfacic node of outside glass-window	4
Indoor surfacic node of outside glass-window	5
Surfacic node of internal wall	6
Internal node of internal wall	7
Surfacic node of vertical interzone wall	8
Internal node of interzone wall	9
Surfacic node of ground wall	10
Internal node of ground wall	11
Terminal node of ground wall	12
Surfacic below node of horizontal interzone wall	13
Surfacic under node of horizontal interzone wall	14
Surfacic node of interzone glass-window	15
Dry indoor air temperature	16
Radiant mean temperature	17

On the building seen in cut of figure 18, we have only represented (with a white round) a few nodes of thermal discretisation. For these nodes, we've pointed out with a number sprung from the former board the corresponding type.

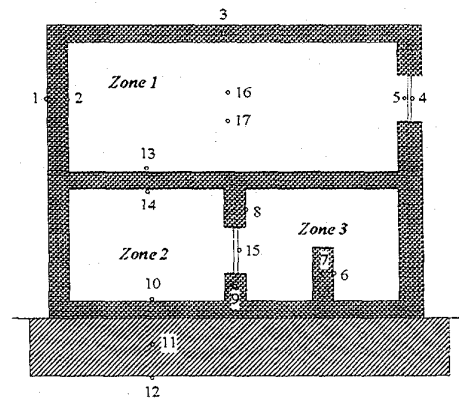


Fig. 18 : Types of nodes.

For a given building, when this structure is established, it's easy to fill up each element of the mathematical model. Indeed, with a loop on the set of nodes, it's possible to test the appartenance of a node to the considered zone and, depending on its type, to affect the associated objects.

This paragraph makes explicit the method on the case of a simplified bizona building supposed without ceiling and floor and those view sketch in horizontal division is given in figure 19. The chosen conductive model in walls is of type 2RC (two surface nodes). The discretisation leads to arrange 18 temperature nodes in this building.

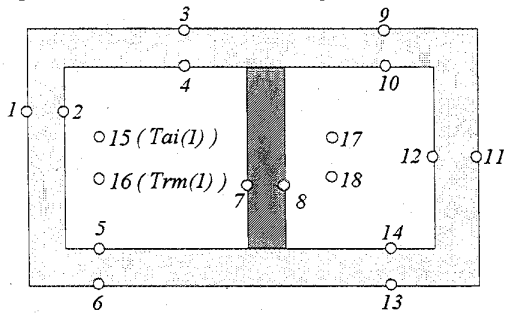


Fig. 19 : Simple two-zone building.

A zone model being defined as the sets of equations of the thermal balance of each node belonging to the zone, the state vector of the first zone is made of $(T_1, T_2, T_3, T_4, T_5, T_6, T_7, T_8, T_{15}, T_{16})$, while the second zones concerns $(T_7, T_8, T_9, T_{10}, T_{11}, T_{12}, T_{13}, T_{14}, T_{17}, T_{18})$. We note that T_7 and T_8 are variables of each state vector, because the corresponding discretisation nodes belong two the recovery zone (hatched on the diagram). Then, each elementary system is of dimension 10.

For the first zone, an illustration of a part of the filling of the objets can be given. We'll take the example of heat conduction terms, constituting a matrix, A_{cond} . $K_{i,j}$ is designating the thermal conductance ($W.m^{-2}.K^{-1}$) between the nodes i and j .

$$A_{cond} = \begin{bmatrix} -K_{1,2} & K_{1,2} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ K_{1,2} & -K_{1,2} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & -K_{3,4} & K_{3,4} & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & K_{3,4} & -K_{3,4} & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & -K_{5,6} & K_{5,6} & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & K_{5,6} & -K_{5,6} & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & -K_{7,8} & K_{7,8} & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & K_{7,8} & -K_{7,8} & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \end{bmatrix}$$

In regard to indoor convection, to simplify the writing, we'll use a linear model with a constant exchange coefficient h_{ci} ($W.m^{-2}.K^{-1}$).

$$A_{cvi} = \begin{bmatrix} 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & -h_{ci} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & h_{ci} & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & -h_{ci} & 0 & 0 & 0 & 0 & 0 & h_{ci} & 0 \\ 0 & 0 & 0 & 0 & -h_{ci} & 0 & 0 & 0 & 0 & h_{ci} & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & -h_{ci} & 0 & 0 & h_{ci} & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \end{bmatrix}$$

ACKNOWLEDGEMENTS

The financial contribution of Reunion Island delegation of A.D.E.M.E. (Agence De l'Environnement et de la Maîtrise de l'Energie) to this study is gratefully acknowledged.

CONCLUSION

Establishing the level of approach of the building professionals, the first part applies the systemic analysis to the thermal design of buildings. The consequence of the splitting up of the building makes evident the sub-system thermal zone and lays the foundations of our description of a building. The data structures linked to the building turn on to be complex due to the diversity of the situations that can be described (the number of zones, the constitution of the covering of the building, the integration of systems, ...). Our focusing on the modelisation method and building description led us to introduce some description windows of our multizone software, *CODYRUN*. Many aspects developed to this day in this software have been purposely put aside, in particular in regard to as the multiple model innovator feature or airflow simulation. Meanwhile, for these points too, our work [Boyer 93b] shows the benefit of systemic analysis.

REFERENCES

- TRNSYS, 1979. *User's guide*. Madison (U.S.A.) : Solar Energy Laboratory, University of Wisconsin, 1650 p.
- Bertalanfy, L, 1968. *General system theory, foundation, development, applications*. G. Braziller, New York.
- Robin, C, 1991. *Intégration de savoir expert et d'outils de simulation pour la conception thermique des bâtiments et des systèmes*. *Phd Thesis*, Institut National des Sciences Appliquées de Lyon, France

Boyer, H., Brau, J., Gatina, J.C. 1993. Multiple model software for airflow and thermal building simulation. A case study under tropical humid climate, in Réunion Island. *In Proceedings of Building Simulation '93*, (IBPSA, Adelaide, Aug.), 111-117.

Clarke, J., A. 1985. Energy simulation in building design. Glasgow (U.K.) : Adam Hilger Ltd, 383 p. ISBN 0-85274-797-7

Walton, G.N., 1989. Airflow network models for element based building airflow modeling. ASHRAE Transactions, Vol. 95, Part. 2, p. 611-620.

A. J. Chapman, *Heat Transfer*, Macmillan Publishing Company, New-York (1984)

J.B. Saulnier, A. Alexandre, La modélisation thermique par la méthode nodale, ses principes, ses succès et ses limites. *Revue Générale de Thermique*, n° 280, 363 - 372, (April 1985)

I. Blanc Sommereux, 1980, Etude du couplage dynamique de composants du bâtiment par synthèse modale. *Phd Thesis*, Ecole des Mines de Paris, France.

Boyer, H., 1993. Conception thermo-aéraulique de bâtiments multizones. Proposition d'un outil à choix multiple des modèles. *Phd Thesis*, Institut National des Sciences Appliquées de Lyon, France.