



**HAL**  
open science

# Robust $H_\infty$ Decentralized Control Design for HVDC Link Embedded in a Large-scale AC Grid

Hoang-Trung Ngo, Elkhatib Kamal, Bogdan Marinescu, Florent Xavier

► **To cite this version:**

Hoang-Trung Ngo, Elkhatib Kamal, Bogdan Marinescu, Florent Xavier. Robust  $H_\infty$  Decentralized Control Design for HVDC Link Embedded in a Large-scale AC Grid. 2020 Electrical Power and Energy Conference, Nov 2020, Edmonton, Alberta, Canada. 10.1109/EPEC48502.2020.9319919 . hal-03172332

**HAL Id: hal-03172332**

**<https://hal.science/hal-03172332v1>**

Submitted on 17 Mar 2021

**HAL** is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

# Robust $H_\infty$ Decentralized Control Design for HVDC Link Embedded in a Large-scale AC Grid

Hoang-Trung NGO\*, Elkhatib Kamal\*, Bogdan Marinescu\* and Florent Xavier†  
\*Ecole Centrale de Nantes, LS2N-CNRS, 1, rue de la Noë, Nantes 44300, France  
Email: {Hoang-Trung.Ngo,Elkhatib.ibrahim, Bogdan.Marinescu}@ec-nantes.fr  
†Réseau de Transport d'Électricité (RTE) de France, Defense, France  
Email: Florent.Xavier@rte-france.com

*Abstract*—This paper proposes a static decentralized controller design method for an HVDC link embedded in a large-scale AC grid based on the Linear Matrix Inequalities (LMIs) technique. The considered studied system is treated as composed by two overlapping subsystems. The interconnection between the two subsystems is nonlinear and is treated by increasing disturbance rejection and robustness against norm-bounded parametric uncertainties of the closed-loop. Indeed, the overall robustness and tracking ability of the entire closed-loop is significantly improved with the proposed controller. This is both analytically ensured in the synthesis of the gains of the regulators and, next proven by validation simulations. The overall robustness and tracking ability of the entire closed loop system can be significantly improved. It is shown that this control can deal with HVDC link with different lengths, including the short ones for each the coupling between the two converters is strong.

Another advantage of the proposed decoupling control is the *resilience*: as no communication is used between the two stations, in case of failure of one converter or loss of measures as control, the control of the other converter is not affected. Moreover, it guarantees the stability of the overall system. Finally, the efficiency and robustness of the proposed controllers are tested and compared with each others, to illustrate the control synthesis and its effectiveness.

*Keywords*—VSC-HVDC,  $H_\infty$  control, robust control, decentralized control, resilience, LMI.

## I. INTRODUCTION

**W**ITH the rapid development in scale of power grid, due to the need of state and (or) output information from far-off regions, the solution with classical centralized control becomes increasingly infeasible. In addition, with the enormous diversity in power supplying, the required information is much harder to obtain as it is the case for the massive integration of dispersed renewable energies on distribution systems. On one hand, controllers should be decentralized as there are many generators to be dealt with. As a matter of fact, flexibility of modern power systems should be increased to operate the systems closer to their limits. In contrast, the robust optimal decentralized control meet the need of having less required information in control, and can still keep the same performance as in the former techniques. Simultaneously, with the gradual evolution of decentralized control from 1980s to 2010s [1], [2] and robust optimal control from 1990s to 2010s [3]-[5], it is now the time for decentralized control development in power systems.

Over long distance, with the increasing in length [6] of modern VSC-HVDC, centralized control become costly and ineffective with introduced delay in feedback signals from remote converters. There are many research works for VSC-HVDC, including decoupling control in converter stations using feedback linearization [7], small signal stability [8] and Linear matrix inequalities (LMIs)-based robust control [9]. Also, multi-terminal HVDC [10], [11] as well as DC grid, with many advantages over AC grid [10]-[28], are rapidly developed and intensively studied in recent years. However, these papers hardly cover the uncertain aspects, and non of them met the need of decentralized techniques.

The main contribution of this paper is a robust  $H_\infty$  decentralized control for embedded HVDC system with external bounded disturbances, in order to improve the resilience of the implementation, the dynamic behavior performance under wide range of parameter uncertainties and to minimize the tracking reference error. The sufficient conditions are formulated in the format of Linear matrix inequalities (LMIs). The controllers proposed herein are synthesized to satisfy  $H_\infty$  performance for disturbance attenuation. Lyapunov function has been employed to satisfy the stability condition. In this paper, we develop LMI stability conditions for the linear system without parametric uncertainties and also for the linear system with uncertainties. The proposed method has the following advantages:

- 1) Overall resilience, robustness and tracking ability of the entire closed loop system can be significantly improved. Moreover, it guarantees the stability of the overall system.
- 2) Improves the dynamic behavior performance under wide range of operating conditions and minimize the tracking reference error.

The rest of the paper is organized as follows. In section II, a state space representation of the HVDC dynamics is given. The proposed robust  $H_\infty$  decentralized control structure is developed in section III. Simulation results that illustrates the effectiveness of the proposed strategies are presented in section IV. Finally, the conclusions and future prospects are presented in section V.

## II. VSC-HVDC POWER STRUCTURE AND ITS DYNAMICS MODEL

### A. VSC-HVDC nonlinear model

Consider a VSC-HVDC link, which interconnects two AC zones:




Fig. 1. VSC-HVDC power structure

If average models are taken for converters, the VSC-HVDC nonlinear system (in figure 1) can be modeled by following differential equations [14]-[17]:

$$(1) \quad \begin{cases} \frac{dx_1}{dt} = \left( -\frac{R_s}{L_{g1}} - \frac{r_{g1}}{L_{g1}} \right) x_1 + \omega x_2 + \frac{R_s}{L_{g1}} x_3 + \frac{E}{L_{g1}} \\ \frac{dx_2}{dt} = \left( -\frac{R_s}{L_{g1}} - \frac{r_{g1}}{L_{g1}} \right) x_2 - \omega x_1 + \frac{R_s}{L_{g1}} x_4 \\ \frac{dx_3}{dt} = \left( -\frac{R_s}{L_{r1}} - \frac{r_{r1}}{L_{r1}} \right) x_3 + \frac{R_s}{L_{r1}} x_1 + \omega x_4 - \frac{x_5}{2L_{r1}} u_1 \\ \frac{dx_4}{dt} = \left( -\frac{R_s}{L_{r1}} - \frac{r_{r1}}{L_{r1}} \right) x_4 + \frac{R_s}{L_{r1}} x_2 - \omega x_3 - \frac{x_5}{2L_{r1}} u_2 \\ \frac{dx_5}{dt} = \frac{3}{2C_1} x_3 u_1 + \frac{3}{2C_1} x_4 u_2 - \frac{2}{C_1} x_6 \\ \frac{dx_6}{dt} = \frac{1}{2L_{DC}} x_5 - \frac{r_{DC}}{L_{DC}} x_6 - \frac{1}{2L_{DC}} x_7 \\ \frac{dx_7}{dt} = \frac{2}{C_2} x_6 + \frac{3}{2C_2} x_{10} u_3 + \frac{3}{2C_2} x_{11} u_4 \\ \frac{dx_8}{dt} = \left( -\frac{R_s}{L_{g2}} - \frac{r_{g2}}{L_{g2}} \right) x_8 + \omega x_9 + \frac{R_s}{L_{g2}} x_{10} + \frac{E}{L_{g2}} \\ \frac{dx_9}{dt} = \left( -\frac{R_s}{L_{g2}} - \frac{r_{g2}}{L_{g2}} \right) x_9 - \omega x_8 + \frac{R_s}{L_{g2}} x_{11} \\ \frac{dx_{10}}{dt} = \left( -\frac{R_s}{L_{r2}} - \frac{r_{r2}}{L_{r2}} \right) x_{10} + \frac{R_s}{L_{r2}} x_8 + \omega x_{11} - \frac{x_7}{2L_{r2}} u_3 \\ \frac{dx_{11}}{dt} = \left( -\frac{R_s}{L_{r2}} - \frac{r_{r2}}{L_{r2}} \right) x_{11} + \frac{R_s}{L_{r2}} x_9 - \omega x_{10} - \frac{x_7}{2L_{r2}} u_4 \end{cases}$$

with:

$$(2) \quad \begin{cases} x_1 = i_{g1d}, & x_2 = i_{g1q} \\ x_3 = i_{1d}^\infty, & x_4 = i_{1q}^\infty \\ x_5 = v_{DC1}, & x_6 = i_{DC} \\ x_7 = v_{DC2}, & x_8 = i_{g2d} \\ x_9 = i_{g2q}, & x_{10} = i_{2d}^\infty \\ x_{11} = i_{2q}^\infty \end{cases} \quad \begin{cases} u_1 = \beta_{1d} \\ u_2 = \beta_{1q} \\ u_3 = \beta_{2d} \\ u_4 = \beta_{2q} \end{cases}$$

The output of the system are:

$$(3) \quad \begin{cases} y_1 = v_{DC1} = x_5 \\ y_2 = Q_1 = \frac{3}{2} R_s x_2 x_3 - \frac{3}{2} R_s x_1 x_4 \\ y_3 = P_2 = \frac{3}{2} R_s x_8 x_{10} - \frac{3}{2} R_s x_{10}^2 + \frac{3}{2} R_s x_9 x_{11} \\ \quad - \frac{3}{2} R_s x_{11}^2 \\ y_4 = Q_2 = \frac{3}{2} R_s x_9 x_{10} - \frac{3}{2} R_s x_8 x_{11} \end{cases}$$

where  $i_{DC}$  is the DC line current,  $v_{DC1}$  is the DC voltage for VSC on left side,  $i_{g1d}$  and  $i_{g1q}$  are the grid current on  $d$  and  $q$  axis for AC filter on the left side, respectively,  $i_{g2d}$ ,  $i_{g2q}$  are the grid current on  $d$  and  $q$  axis for AC filter on the right side,  $\beta_{1d}$ ,  $\beta_{1q}$ ,  $v_{DC1}$  are variables for VSC on left side,  $\beta_{2d}$ ,  $\beta_{2q}$ ,  $v_{DC2}$  are variables for VSC on right side ( $\beta_{ij}$ ,  $i \in \{1, 2\}$ ,  $j \in \{1, 2\}$  are the duty ratios of the converters, i.e., the controls of the VSC system),  $i_{2d}^\infty$ ,  $i_{2q}^\infty$  are AC grid currents on the right side,  $i_{1d}^\infty$ ,  $i_{1q}^\infty$  are AC grid currents on the left side,  $L_{g1}$ ,  $L_{g2}$ ,  $r_{g1}$ ,  $r_{g2}$ ,  $L_{r1}$ ,  $L_{r2}$ ,  $r_{r1}$ ,  $r_{r2}$ ,  $R_s$ ,  $C_1$ ,

$C_2$ ,  $r_{DC}$ ,  $L_{DC}$ ,  $E$  and  $\omega$  are constants,  $P_2$ ,  $Q_1$ ,  $Q_2$  are active power and reactive power, respectively. The system parameters are:

S.N	Variable Names	Constants	Values
1	AC grid inductance	$L_{g1} = L_{g2}$	0.11 H
2	AC grid resistance	$r_{g1} = r_{g2}$	0.01 $\Omega$
3	Filter inductance	$L_{r1} = L_{r2}$	0.025 H
4	Filter resistance	$r_{r1} = r_{r2}$	0.01 $\Omega$
5	AC filter resistance	$R_s$	2 $\Omega$
6	DC capacitor filter	$C_1 = C_2$	220 * 10 <sup>-6</sup> F
7	DC line resistance	$r_{DC}$	1.39 $\Omega$
8	DC line inductance	$L_{DC}$	1.59 * 10 <sup>-2</sup> H
9	Grid voltage	$E$	187 * 10 <sup>3</sup> V
10	Grid frequency	$\omega$	314 rad/sec

### B. Exact Linearization of VSC-HVDC nonlinear model

The HVDC model (1) is a nonlinear model in the form of:

$$\dot{X} = f(X, U), \quad Y = g(X) \quad (4)$$

Hence, its linearization around an equilibrium point  $(X^*, U^*)$  is:

$$\Delta \dot{X} = A \Delta X + B \Delta U, \quad \Delta Y = C \Delta X \quad (5)$$

where:

$$\Delta X = X - X^*, \Delta U = U - U^*, A = \left. \frac{\partial f(X, U)}{\partial X} \right|_{(X^*, U^*)}$$

$$B = \left. \frac{\partial f(X, U)}{\partial U} \right|_{(X^*, U^*)}, C = \left. \frac{\partial g(X, U)}{\partial X} \right|_{(X^*, U^*)}$$

$$X^* =$$

$$\begin{bmatrix} x_1^* & x_2^* & x_3^* & x_4^* & x_5^* & x_6^* & x_7^* & x_8^* & x_9^* & x_{10}^* & x_{11}^* \end{bmatrix}^T$$

$$U^* = \begin{bmatrix} u_1^* & u_2^* & u_3^* & u_4^* \end{bmatrix}^T$$

$$A = \begin{bmatrix} A_{11} & A_{12} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ A_{21} & A_{22} & A_{23} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & A_{33} & 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \end{bmatrix}, B = \begin{bmatrix} B_{11} & 0 \\ B_{21} & B_{22} \\ 0 & B_{32} \end{bmatrix}, C = \begin{bmatrix} C_{11} & 0 \\ C_{12} & C_{22} \\ 0 & C_{23} \end{bmatrix}^T$$

with:

$$A_{12} = \begin{bmatrix} 0 & 0 & 0 & 0 & -\frac{2}{C_1} \end{bmatrix}^T, A_{21} = \begin{bmatrix} 0 & 0 & 0 & 0 & \frac{1}{2L_{DC}} \end{bmatrix};$$

$$A_{22} = \begin{bmatrix} -\frac{r_{DC}}{L_{DC}} \end{bmatrix}$$

$$A_{23} = \begin{bmatrix} -\frac{1}{2L_{DC}} & 0 & 0 & 0 & 0 \end{bmatrix}, A_{32} = \begin{bmatrix} \frac{2}{C_2} & 0 & 0 & 0 & 0 \end{bmatrix}^T$$

$$A_{11} =$$

$$\begin{bmatrix} -\frac{R_s}{L_{g1}} - \frac{r_{g1}}{L_{g1}} & \omega & \frac{R_s}{L_{g1}} & 0 & 0 \\ -\omega & -\frac{R_s}{L_{g1}} - \frac{r_{g1}}{L_{g1}} & 0 & \frac{R_s}{L_{g1}} & 0 \\ \frac{R_s}{L_{r1}} & 0 & -\frac{R_s}{L_{r1}} - \frac{r_{r1}}{L_{r1}} & \omega & -\frac{u_1^*}{2L_{r1}} \\ 0 & \frac{R_s}{L_{r1}} & -\omega & -\frac{R_s}{L_{r1}} - \frac{r_{r1}}{L_{r1}} & -\frac{u_2^*}{2L_{r1}} \\ 0 & 0 & \frac{3u_1^*}{2C_1} & \frac{3u_2^*}{2C_1} & 0 \end{bmatrix}$$

$$A_{33} =$$

$$\begin{bmatrix} 0 & 0 & 0 & \frac{3u_3^*}{2C_2} & \frac{3u_4^*}{2C_2} \\ 0 & -\frac{R_s}{L_{g2}} - \frac{r_{g2}}{L_{g2}} & \omega & \frac{R_s}{L_{g2}} & 0 \\ 0 & -\omega & -\frac{R_s}{L_{g2}} - \frac{r_{g2}}{L_{g2}} & 0 & \frac{R_s}{L_{g2}} \\ -\frac{u_3^*}{2L_{r2}} & \frac{R_s}{L_{r2}} & 0 & -\frac{R_s}{L_{r2}} - \frac{r_{r2}}{L_{r2}} & \omega \\ -\frac{u_4^*}{2L_{r2}} & 0 & \frac{R_s}{L_{r2}} & -\omega & -\frac{R_s}{L_{r2}} - \frac{r_{r2}}{L_{r2}} \end{bmatrix}$$

$$\begin{aligned}
B_{11} &= \begin{bmatrix} 0 & 0 \\ 0 & 0 \\ -\frac{x_5^*}{2L_{r1}} & 0 \\ 0 & -\frac{x_5^*}{2L_{r1}} \\ \frac{3x_3^*}{2C_1} & \frac{3x_4^*}{2C_1} \end{bmatrix}; B_{32} = \begin{bmatrix} \frac{3x_{10}^*}{2C_2} & \frac{3x_{11}^*}{2C_2} \\ 0 & 0 \\ 0 & 0 \\ -\frac{x_7^*}{2L_{r2}} & 0 \\ 0 & -\frac{x_7^*}{2L_{r2}} \end{bmatrix} \\
B_{21} &= \begin{bmatrix} 0 & 0 \end{bmatrix}; B_{22} = \begin{bmatrix} 0 & 0 \end{bmatrix} \\
C_{11} &= \begin{bmatrix} 0 & 0 & 0 & 0 & 1 \\ -\frac{3R_s x_4^*}{2} & \frac{3R_s x_3^*}{2} & \frac{3R_s x_2^*}{2} & -\frac{3R_s x_1^*}{2} & 0 \end{bmatrix} \\
C_{12} &= \begin{bmatrix} 0 \\ 0 \end{bmatrix}; C_{22} = \begin{bmatrix} 0 \\ 0 \end{bmatrix} \\
C_{23} &= \begin{bmatrix} 0 & \frac{3R_s x_{10}^*}{2} & \frac{3R_s x_{11}^*}{2} & \frac{3R_s x_8^*}{2} - 3R_s x_{10}^* & \frac{3R_s x_9^*}{2} - 3R_s x_{11}^* \\ 0 & -\frac{3R_s x_{11}^*}{2} & \frac{3R_s x_{10}^*}{2} & \frac{3R_s x_9^*}{2} & -\frac{3R_s x_8^*}{2} \end{bmatrix}
\end{aligned}$$

### C. Decentralized HVDC linear model

The linearized HVDC system (5) can be rewritten into 2 overlapping subsystems:

$$\begin{aligned}
(I) \quad & \begin{cases} \dot{X}_1 = A_1 X_1 + B_1^1 U_1 + B_2^1 W_1 \\ Y_1 = C_1 X_1 \end{cases} \\
(II) \quad & \begin{cases} \dot{X}_2 = A_2 X_2 + B_1^2 U_2 + B_2^2 W_2 \\ Y_2 = C_2 X_2 \end{cases}
\end{aligned} \quad (6)$$

where  $W_1 = x_7$  for system (I),  $W_1 = x_5$  for system (II),  $x_6$  is the common state, and:

$$\begin{aligned}
X_1 &= [x_1 \ x_2 \ x_3 \ x_4 \ x_5 \ x_6]^T \\
X_2 &= [x_6 \ x_7 \ x_8 \ x_9 \ x_{10} \ x_{11}]^T \\
A_1 &= \begin{bmatrix} A_{11} & A_{12} \\ A_{21} & A_{22} \end{bmatrix}; A_2 = \begin{bmatrix} A_{22} & A_{23} \\ A_{32} & A_{33} \end{bmatrix} \\
B_1^1 &= \begin{bmatrix} B_{11} \\ B_{21} \end{bmatrix}; B_1^2 = \begin{bmatrix} B_{22} \\ B_{32} \end{bmatrix} \\
C_1 &= [C_{11} \ C_{12}]; C_2 = [C_{22} \ C_{23}] \\
B_2^1 &= [0 \ 0 \ 0 \ 0 \ 0 \ \frac{-1}{2L_{DC}}]^T \\
B_2^2 &= [\frac{1}{2L_{DC}} \ 0 \ 0 \ 0 \ 0 \ 0]^T
\end{aligned}$$

### D. Extended System for Reference Tracking

Each subsystem in decentralized linearized HVDC system (equation (6)) is in the form of a linear system with disturbance

$$\dot{X} = AX + B_1 U + B_2 W, \quad Y = CX \quad (7)$$

with the error between output and the reference

$$e = -CX + Y_{ref}. \quad (8)$$

Consider the extended state and output are:

$$\bar{X} = \begin{bmatrix} \dot{X} \\ e \end{bmatrix}; \bar{Y} = e \quad (9)$$

As a result, the extended system to be stabilized in order to ensure references tracking is:

$$\begin{cases} \dot{\bar{X}} = \begin{bmatrix} A & 0 \\ -C & 0 \end{bmatrix} \bar{X} + \begin{bmatrix} B_1 \\ 0 \end{bmatrix} \dot{U} + \begin{bmatrix} B_2 \\ 0 \end{bmatrix} \dot{W} \\ Y = [0 \ I] \bar{X} \end{cases} \quad (10)$$

## III. PROPOSED ROBUST $H_\infty$ DECENTRALIZED STATE FEEDBACK CONTROL FOR HVDC LINE

This section presents a systematic proposed robust  $H_\infty$  decentralized state feedback control for HVDC to compensate the effect parameter uncertainties and regulate output variable taking. We will develop first new stability conditions based on LMI [18]-[28] for the uncertainty-free case. After that, we will generalize our results by considering the norm-bounded parametric uncertainties.

Our first objective is the design of the following linear robust  $H_\infty$  decentralized state feedback controller using integral action as the following:

$$\dot{U} = \bar{K} \bar{X} \Rightarrow U = \bar{K} \left[ \int X \, edt \right] \quad (11)$$

### A. Synthesis of Uncertainty-Free $H_\infty$ Decentralized Control

Consider the linear system which includes systems as (10):

$$\begin{cases} \dot{X} = AX + B_1 U + B_2 W \\ Y = CX + D_1 U + D_2 W \end{cases} \quad (12)$$

The influence of the disturbance  $W$  to the output  $Y$  is:

$$Y(s) = G(s) W(s) \quad (13)$$

where:

$$G(s) = (C + D_1 K)(sI - (A + B_1 K))^{-1} B_2 + D_2 \quad (14)$$

By using disturbance rejection, in the case of decentralized control in HVDC link, we successfully minimize the effect of one converter to the other converter's control, i.e., decouple the coupling between these two converters.

$$\|Y\|_2 \leq \|G\|_\infty \|W\|_2 \quad (15)$$

*Problem 1:* For the linear system (12), the  $H_\infty$  problem is to design a state feedback control law such that:

$$\sup_{\|W\|_2 \neq 0} \frac{\|Y\|_2}{\|W\|_2} \leq \gamma \quad (16)$$

hold for a given positive scalar  $\gamma$ .

In the uncertainty-free case, stability and robustness analysis is summarized in the following Theorem 1.

*Theorem 1:* The  $H_\infty$  problem has a solution if and only if there exist a matrix  $W_p$  and a symmetric positive definite matrix  $X_p$ , such that:

$$\begin{aligned}
& \min_{X_p, W_p} \gamma \\
& \begin{bmatrix} \Psi & B_2 & (CX_p + D_1 W_p)^T \\ B_2^T & -\gamma I & D_2^T \\ CX_p + D_1 W_p & D_2 & -\gamma I \end{bmatrix} < 0 \\
& \Psi = (AX_p + B_1 W_p)^T + AX_p + B_1 W_p
\end{aligned} \quad (17)$$

And, the solution of the problem can be given as:

$$K = W_p X_p^{-1} \quad (18)$$

*Proof:*

It is well-known that with linear system:

$$\begin{cases} \dot{X} = AX + BU \\ Y = CX + DU \end{cases} \quad (19)$$

The  $H_\infty$  problem with this system:

$$\begin{cases} Y = G(s)U \\ G(s) = C(sI - A)^{-1}B + D \end{cases} \quad (20)$$

is solved by [5], [29] if and only if there exist a symmetric positive definite matrix  $X_p$ , such that:

$$\begin{bmatrix} X_p A^T + AX_p & B & X_p C^T \\ B^T & -\gamma I & D^T \\ CX_p & D & -\gamma I \end{bmatrix} < 0 \quad (21)$$

Apply this for the linear system with disturbance (equation (12)), the  $H_\infty$  problem for the linear system with disturbance (12), and by defining  $W_p = KX_p$ , the inequality turns into Theorem 1. ■

### B. Synthesis of Uncertainty $H_\infty$ Decentralized Control

In this subsection, we consider the problem of norm-bounded parametric uncertainties. As discussed in the uncertainty-free case, by considering the coupling between the two converters in HVDC link as disturbance, the effect of one converter to the other converter's control is minimized by the mean of disturbance rejection. Here, the uncertainties are taken into account since the HVDC links with uncertainties are popular.

Recall that the norm-bounded parametric uncertainties were assumed the linear system with uncertainty, which includes systems as (10):

$$\begin{cases} \dot{X} = (A + \Delta A)X + (B_1 + \Delta B_1)U + B_2W \\ Y = CX + D_1U + D_2W \end{cases} \quad (22)$$

where:

$$\begin{cases} \begin{bmatrix} \Delta A & \Delta B_1 \end{bmatrix} = HF \begin{bmatrix} E_1 & E_2 \end{bmatrix} \\ E_1 = \delta_1 A; |\delta_1| < r_1; r_1 \in R^+ \\ E_2 = \delta_2 B_1; |\delta_2| < r_2; r_2 \in R^+ \\ F^T F \leq I \end{cases} \quad (23)$$

The influence of the disturbance  $W$  to the output  $Y$  is determined by:

$$Y(s) = G(s)W(s) \quad (24)$$

where:

$$G(s) = (C + D_1K)(sI - ((A + \Delta A) + (B_1 + \Delta B_1)K))^{-1}B_2 + D_2 \quad (25)$$

**Problem 2:** For the uncertain linear system, the robust  $H_\infty$  problem is to design a state feedback control law such that:

$$\sup_{\|W\|_2 \neq 0} \frac{\|Y\|_2}{\|W\|_2} \leq \gamma \quad (26)$$

hold for a given positive scalar  $\gamma$ .

The second approach for the design of new LMI stability conditions, for the linear system (22) in the uncertainty case is summarized in the following Theorem 2.

**Theorem 2:** The robust  $H_\infty$  problem has a solution if and only if there exist a positive scalar  $\alpha$ , a matrix  $W_p$  and a symmetric positive definite matrix  $X_p$ , such that:

$$\begin{aligned} & \min_{X_p, W_p} \gamma \\ & \begin{bmatrix} \Psi & B_2 & (CX_p + D_1W_p)^T & (E_1X_p + E_2W_p)^T \\ B_2^T & -\gamma I & D_2^T & 0 \\ CX_p + D_1W_p & D_2 & -\gamma I & 0 \\ E_1X_p + E_2W_p & 0 & 0 & -\alpha I \end{bmatrix} < 0 \end{aligned} \quad (27)$$

where,  $\Psi = (AX_p + B_1W_p)^T + AX_p + B_1W_p + \alpha HH^T$ . And, the solution of the problem can be given as:

$$K = W_p X_p^{-1} \quad (28)$$

*Proof:*

First, we introduce the well-known lemma [5], [29]:

**Lemma 1:** The following inequality hold:

$$Q + MFN + N^T F^T M^T < 0, \forall F^T F < I \quad (29)$$

if and only if there exist  $\alpha > 0$  such that:

$$Q + \alpha MM^T + \alpha^{-1} N^T N < 0 \quad (30)$$

Now, apply theorem 1 with  $G(s)$  in the form of equation (25), we have:

$$\begin{aligned} & \begin{bmatrix} \langle AX_p + B_1W_p \rangle_s & B_2 & (CX_p + D_1W_p)^T \\ B_2^T & -\gamma I & D_2^T \\ CX_p + D_1W_p & D_2 & -\gamma I \end{bmatrix} \\ & + \left\langle \begin{bmatrix} H \\ 0 \\ 0 \end{bmatrix} F \begin{bmatrix} E_1X_p + E_2W_p & 0 & 0 \end{bmatrix} \right\rangle_s < 0 \end{aligned} \quad (31)$$

From this, applying lemma 1 with:

$$\begin{cases} Q = \begin{bmatrix} \langle AX_p + B_1W_p \rangle_s & B_2 & (CX_p + D_1W_p)^T \\ B_2^T & -\gamma I & D_2^T \\ CX_p + D_1W_p & D_2 & -\gamma I \end{bmatrix} \\ M = \begin{bmatrix} H \\ 0 \\ 0 \end{bmatrix}; N = \begin{bmatrix} E_1X_p + E_2W_p & 0 & 0 \end{bmatrix} \end{cases}$$

This inequality can be equivalently written as:

$$\begin{aligned} & \begin{bmatrix} \Psi & B_2 & (CX_p + D_1W_p)^T \\ B_2^T & -\gamma I & D_2^T \\ CX_p + D_1W_p & D_2 & -\gamma I \\ E_1X_p + E_2W_p & 0 & 0 \end{bmatrix} \\ & + \alpha^{-1} \begin{bmatrix} 0 & 0 & 0 \end{bmatrix} \begin{bmatrix} E_1X_p + E_2W_p & 0 & 0 \end{bmatrix} < 0 \end{aligned} \quad (32)$$

Where:

$$\Psi = \langle AX_p + B_1W_p \rangle_s + \alpha HH^T \quad (33)$$

This inequality, according to Schur complement lemma [5], [29]-[30], is equivalent to the inequality (27) of Theorem 2. ■

#### IV. SIMULATIONS AND RESULTS

In this section, our control methodologies are applied to HVDC system with varying line length (110 Km, 750 Km, 1400 Km), in robust ( $H_{inf}RDC$ ) and non-robust ( $H_{inf}DC$ ) version, and in case of loss of control in one of the two converter in the HVDC line.

In the first figures (figure 2 to figure 3), the comparison between robust (problem 2) and non-robust (problem 1) version of  $H_\infty$  decentralized control is conducted, with 20% uncertainty. The robust version of  $H_\infty$  control has much smaller overshoot and shorter transient time. The uncertainty is an increase of 20% of matrices  $A$  and  $B_1$  in system (22), i.e. an increase of 20% of  $R_s, r_{g1}, r_{r1}, r_{g2}, r_{r2}$ , and a decrease of 17.3% of  $L_{DC}, L_{r1}, L_{g1}, C_1, L_{r2}, L_{g2}$ .

The comparison for the robust HVDC decentralized  $H_\infty$  control, in different lengths of line (110 Km, 750 Km, 1400 Km), is presented from figure 4 to figure 5 with uncertainty (robust version). There is an obvious relationship between the line length and the converter's performance: the longer the length is, the better performance the converter's performance is. This can be explained by carefully examining the HVDC equation system, where there is a strong coupling between  $v_{DC1}$  and  $v_{DC2}$ . By increasing the length,  $r_{DC}$  and  $L_{DC}$  will be increased, lead to the weaker coupling between these voltages. These couplings are handled here as disturbances and parametric uncertainties in the robust control (problem 2). Improvement is significant for short HVDC lines (110 Km) and oscillations due to interaction are completely damped for longer lines.

In case of loss of control in one converter (input control of this converter is now equal to zero), the other converter still operates properly. This is demonstrated from the figure 6 to figure 7 (loss of control in converter 1, i.e. loss of control in  $v_{DC1}$  and  $Q_1$ ), and from figure 8 to figure 9 (loss of control in converter 2, i.e. loss of control in  $P_2$  and  $Q_2$ ).

#### V. CONCLUSION

In this paper it is proposed a *decentralized control* of HVDC links. It has the advantage to propose two independent controls for each converter. Independence is at all levels: synthesis, implementation and use of measures. This is an advantage over classic vector controls which have separate synthesis but use feedback from the other converter to separate dynamics.

Our control provides *resilience*: in case of failure on a converter (measure or loss of control), the control of the other converter is not influenced. No communication between the two stations is needed.

The natural coupling between the dynamics of the two converters is treated as disturbance and rejected by advanced control. The gains are synthesized by solving LMIs to analytically guarantee stability of the whole closed-loop (i.e., for the whole HVDC connected to the grid).

Coupling between the converters is quantified by the length of the HVDC link. The  $H_\infty$  LMI-baed synthesis mentioned above provides also increased parametric robustness as well as disturbance rejection. As a consequence, the effect of coupling is well counteracted and good results are obtained even for

short HVDC links (and thus the strong coupling between the two converters).

In future work we will validate this control methodology on HVDCs inserted in a more detailed AC grid as well as hardware-on-the-loop platform. Also, this decoupling control methodology will be further used for other power systems problems such as, e.g., insertion of renewable sources generators in AC grids with high request of ancillary services.

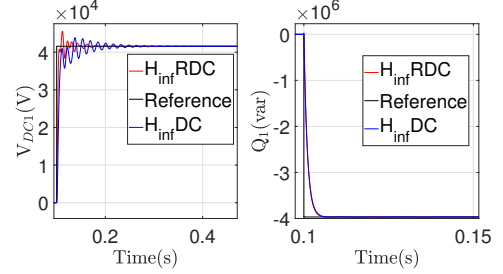


Fig. 2. Voltage  $v_{DC1}$  and reactive power  $Q_1$  in 110 Km line (robust and non-robust)

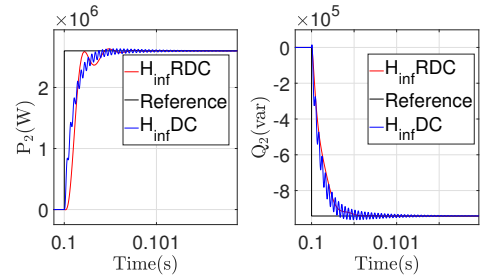


Fig. 3. Active power  $P_2$  and reactive power  $Q_2$  in 110 Km line (robust and non-robust)

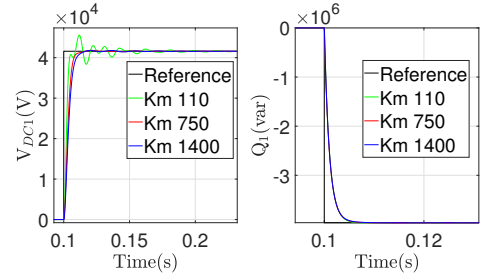


Fig. 4. Voltage  $v_{DC1}$  & reactive power  $Q_1$  in 110, 750, 1400 Km line (20% uncertainty)

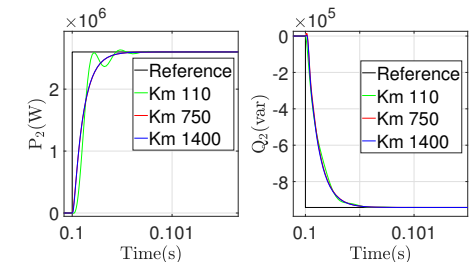


Fig. 5. Active & reactive power  $P_2, Q_2$  in 110, 750, 1400 Km line (20% uncertainty)

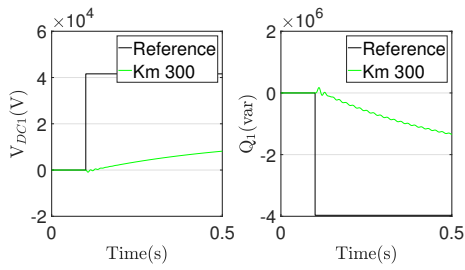


Fig. 6. Voltage & reactive power  $v_{DC1}$ ,  $Q_1$  (converter 1 control loss)

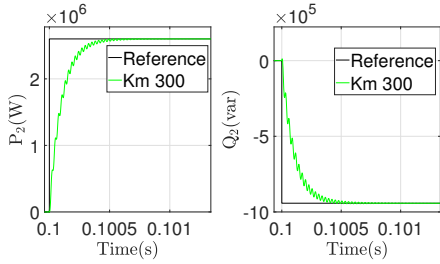


Fig. 7. Active & reactive power  $P_2$ ,  $Q_2$  (converter 1 control loss)

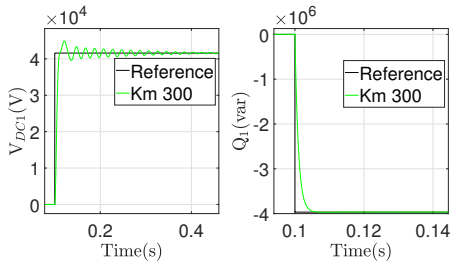


Fig. 8. Voltage & reactive power  $v_{DC1}$ ,  $Q_1$  (converter 2 control loss)

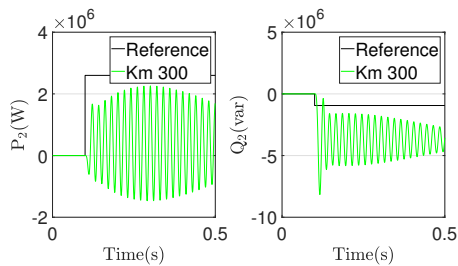


Fig. 9. Active & reactive power  $P_2$ ,  $Q_2$  (converter 2 control loss)

## REFERENCES

- [1] Siljak, Dragoslav D. Decentralized control of complex systems. Courier Corporation, 2011.
- [2] LEONDES, Cornelius T. "Control and dynamic systems: Decentralized/distributed control and dynamic systems. Part 3((Book))." Orlando, FL, Academic Press, Inc.(Advances in Theory and Applications. 24 (1986).
- [3] Zhou, Kemin, and John Comstock Doyle. Essentials of robust control. Vol. 104. Upper Saddle River, NJ: Prentice hall, 1998.
- [4] Zhou, Kemin, John Comstock Doyle, and Keith Glover. Robust and optimal control. Vol. 40. New Jersey: Prentice hall, 1996.
- [5] Duan, Guang-Ren, and Hai-Hua Yu. LMIs in control systems: analysis, design and applications. CRC press, 2013.
- [6] Alassi, Abdulrahman, et al. "HVDC transmission: technology review, market trends and future outlook." Renewable and Sustainable Energy Reviews 112 (2019): 530-554.
- [7] G. Zhang and Z. Xu, Steady-state model for VSC based HVDC system and its controller design, IEEE Power Engineering Society Winter Meeting, vol.3, pp.1085-1090, 2001.
- [8] G. Asplund, Application of HVDC Light to power system enhancement, IEEE Power Engineering Society Winter Meeting, Vol.4, Jan 2000,pp.2498-2503.
- [9] G. B. Zhang, Z. Xu and G. Z. Wang, Steady state model and its nonlinear control of VSC-HVDC system, Proc. CSEE, vol.22, part-1, pp.17-22, 2002.
- [10] Van Hertem, Dirk, and Mehrdad Ghandhari. "Multi-terminal VSC HVDC for the European supergrid: Obstacles." Renewable and sustainable energy reviews 14.9 (2010): 3156-3163.
- [11] Rahimi, Ebrahim, et al. "Commutation failure analysis in multi-infeed HVDC systems." IEEE Transactions on power delivery 26.1 (2010): 378-384.
- [12] Robinson, Jonathan, Dragan Jovcic, and Géza Joós. "Analysis and design of an offshore wind farm using a MV DC grid." IEEE Transactions on Power Delivery 25.4 (2010): 2164-2173.
- [13] Jovcic, Dragan. High voltage direct current transmission: converters, systems and DC grids. John Wiley & Sons, 2019.
- [14] E. Kamal, and B. Marinescu. "Robust Control of VSC-HVDC System with Input and States Constraints." 14th International Workshop on Advanced Control and Diagnosis. No. 16-17. 2017.
- [15] Munteanu, Iulian, Bogdan Marinescu, and Florent Xavier. "Study of interactions between close HVDC links inserted in an AC grid: A mixed nonlinear and modal analysis approach." International Transactions on Electrical Energy Systems 30.4 (2020): e12266.
- [16] L. Arioua and B. Marinescu, Multivariable control with grid objectives of an HVDC link embedded in a large-scale AC grid ,Int. J. Electrical Power and Energy Systems, vol. 72, pp.99-108, 2015.
- [17] L. Arioua and B. Marinescu, Robust grid-oriented control of high voltage DC links embedded in an AC transmission system, Int. J. Robust Nonlinear Control, vol. 26, pp.1944-1961, 2016.
- [18] E. Kamal, A. Aitouche, R. Ghorbani and M. Bayart, Robust nonlinear control of wind energy conversion systems, Int. J. Electr Power Energy Syst., vol.44, no.1, pp. 202-209, 2013.
- [19] E. Kamal and A. Aitouche, Robust fault tolerant control of DFIG wind energy systems with unknown inputs, Renewable Energy, vol.56, pp. 2-15, 2013.
- [20] E. Kamal and A. Aitouche, Fuzzy Observer-Based Fault Tolerant Control Against Sensor Faults for Proton Exchange Membrane Fuel Cells, Int. J. of Hydrogen Energy, vol.45, pp.11220-11232, 2018.
- [21] E. Kamal, A. Aitouche, and D. Abbas, Robust fuzzy scheduler fault tolerant control of wind energy systems subject to sensor and actuator faults, Int. J. Electr Power Energy Syst., vol. 55, no.1, pp. 402-419, 2014.
- [22] E. Kamal, A. Aitouche, Fuzzy fault-tolerant control of wind-diesel hybrid systems subject to sensor faults, IEEE Transactions on Sustainable Energy, vol. 4, no 4, pp. 857-866, 2013.
- [23] E. Kamal, A. Aitouche, Robust scheduler fuzzy controller of DFIG wind energy systems, IEEE Transactions on Sustainable Energy, vol. 4, no 3, pp. 706-715, 2013.
- [24] E. Kamal, A. Aitouche, R. Ghorbani and M. Bayart, Robust fuzzy fault tolerant control of wind energy conversion systems subject to sensor faults, IEEE Transactions on Sustainable Energy, vol. 3, no 2, pp. 231-241, 2012.
- [25] E. Kamal, A. Aitouche and M. Bayart, Intelligent control of WECS subject to parameter uncertainties, Actuator and Sensor Faults, Acta Press, Control and Intelligent Systems, vol. 40, no 3, pp. 1-9, 2012.
- [26] E. Kamal, A. Aitouche, R. Ghorbani and M. Bayart, Robust fuzzy logic control of wind energy conversion systems with unknown inputs, Acta Press, International Journal Power and Energy Systems, vol. 32, no 2, pp. 71-81, 2012.
- [27] E. Kamal, A. Aitouche, R. Ghorbani and M. Bayart, Fuzzy scheduler fault tolerant control for wind energy conversion systems, IEEE Trans. on Control Syst. Technol., vol. 22, no. 1, pp. 119-131, 2014.
- [28] E. Kamal, M. Koutb, A. A. Sobaih and B. Abozalam, An intelligent maximum power extraction algorithm for hybrid wind-diesel-storage system, Int. J. Electr. Power Energy Syst., vol. 32, no. 3, p. 170-177, 2010.
- [29] Boyd, Stephen, et al. "Linear matrix inequalities in system and control theory." (1997).
- [30] Zhang, Fuzhen, ed. The Schur complement and its applications. Vol. 4. Springer Science & Business Media, 2006.