



## How climate change may shift power demand in Japan: Insights from data-driven analysis

Léna Gurriaran, Katsumasa Tanaka, Kiyoshi Takahashi, Philippe Ciais

### ► To cite this version:

Léna Gurriaran, Katsumasa Tanaka, Kiyoshi Takahashi, Philippe Ciais. How climate change may shift power demand in Japan: Insights from data-driven analysis. *Journal of Environmental Management*, 2023, 345, pp.118799. 10.1016/j.jenvman.2023.118799 . hal-04205144

HAL Id: hal-04205144

<https://hal.science/hal-04205144v1>

Submitted on 22 Nov 2024

**HAL** is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.



Distributed under a Creative Commons Attribution 4.0 International License

# How climate change may shift power demand in Japan: insights from data-driven analysis

Léna Gurriaran<sup>a,b,\*\*\*</sup>, Katsumasa Tanaka<sup>a,c,\*</sup>, Kiyoshi Takahashi<sup>d</sup> and Philippe Ciais<sup>a</sup>

<sup>a</sup>*Laboratoire des Sciences du Climat et de l'Environnement (LSCE), IPSL, CEA/CNRS/UVSQ, Université Paris-Saclay, Gif-sur-Yvette, France*

<sup>b</sup>*ATOS, River Ouest, Bezons cedex, 95877, France*

<sup>c</sup>*Earth System Division, National Institute for Environmental Studies (NIES), Tsukuba, Japan*

<sup>d</sup>*Social System Division, National Institute for Environmental Studies (NIES), Tsukuba, Japan*

*\*\*\*Principal corresponding author*

*\*Corresponding author*

## ARTICLE INFO

*Keywords:* climate change power demand carbon intensity CO<sub>2</sub> emissions machine learning

## ABSTRACT

The impact of climate change on power demand in Japan and its related CO<sub>2</sub> emissions is a matter of concern for the Japanese authorities and power companies as it may have consequences on the power grid, but is also of global importance as Japan is a significant contributor to global greenhouse gas emissions. In this study, we trained random forest models against daily power data in ten Japanese regions and for different types of power generation to project changes in future power production and its carbon intensity. We used climate variables, heat stress indices, and one variable for the level of human activities. We then used the models trained from the present-day period to estimate the future power demand, carbon intensity, and pertaining CO<sub>2</sub> emissions over the period 2020-2100 under three Shared Socioeconomic Pathways (SSPs) scenarios (SSP126, SSP370, and SSP585). The impact of climate change on CO<sub>2</sub> emissions via power generation shows seasonal and regional disparities. In cold regions, a decrease in power demand during winter under future warming leads to an overall decrease in power demand over the year. In contrast, the decrease in winter power demand in hot regions can be overcompensated by an increase in summer power demand due to more frequent hot days, resulting in an overall annual increase. From our regional models, power demand is projected to increase the most in most Japanese regions in May, June, September, and October rather than in the middle of summer, as found in previous studies. This increase could result in regular power outages during those months as the power grid could become particularly tense. Overall, we observed that power demand in regions with extreme climates is more sensitive to global warming than in temperate regions. The impact of climate change on power demand induces a net annual decrease in CO<sub>2</sub> emissions in all regions except for Okinawa, in which power

demand strongly increases during the summer, resulting in a net annual increase in CO<sub>2</sub> emissions. However, climate change's impact on carbon intensity may reverse the trend in some regions (Shikoku, Tohoku). Additionally, we assessed the relative impacts of socioeconomic factors such as population, GDP, and environmental policies on CO<sub>2</sub> emissions. When combined with these factors, we found that the climate change effect is more important than when considered individually and significantly impacts total CO<sub>2</sub> emissions under SSP585. The contrasting results observed in the warm and cold regions of Japan can offer valuable insight into the potential future variations in energy demand and resulting CO<sub>2</sub> emissions on a global scale.

## 1. Introduction

Many studies have investigated the impact of climate change on energy systems. According to the review of Yalew et al. (2020), a slight decrease in hydropower and thermal energy capacity at a global scale is expected. However, the impact of climate on power demand strongly varies across regions (Auffhammer et al., 2017; Van Ruijven et al., 2019; Gurriaran et al., 2023). Van Ruijven et al. (2019) found that the energy demand could increase by 25% in the tropics by 2050 due to increasing hot days, whereas higher latitudes are more prone to a decline in energy demand. This study focuses on power demand, which comprises a significant percentage of the total energy demand. Power demand is closely related to meteorological conditions, and there is an increasing concern over how it will respond to changing climate. According to Yalew et al. (2020), a global increase in cooling demand and a decrease in heating demand are expected. For example, heat waves are becoming more frequent and intense in hot regions (Zittis, 2021), causing increased peak demand during those events. The potential power outages that may result from increased peak demand are a matter of concern for health systems (Patel, 2022). Depending on the scenario of socioeconomic development, 2 to 5 billion people are at risk of facing deadly heat and are unable to afford air conditioning systems (Mora, 2017; Andrijevic, 2021). CO<sub>2</sub> emissions from power generation constitute a further consequence of climate-induced changes in power demand. An increase in demand for air conditioning and, thus, power generation in subtropical latitudes will subsequently increase the amount of CO<sub>2</sub> emissions from these regions. However, this effect may be counterbalanced at a global scale by a decrease in heating demand in high latitudes leading to lower CO<sub>2</sub> emissions. Our study addresses this phenomenon specifically in Japan. Japan is one of the largest economies in the world, with the third-largest Gross Domestic Product (GDP) internationally (IMF, 2022).

In 2020, power generation reached 987 TWh, i.e., 7.9 MWh per capita (IEA, 2020), ranking the country in the top 20 largest consumers of electricity per capita in the world. The residential sector is the third largest sector for power demand in Japan, after commercial and public services and industry. Japan comprises a territory ranging from 46° to 20° north (2200 km long from northeast to southwest), and de facto includes a wide range of climates, from humid continental to subtropical. The country is divided into ten distinct geographical areas administered by designated

power companies. Each region is characterized by a specific climate, population density, urbanization rate, GDP per capita, etc., all factors determining power demand. For example, the adoption rate of household air conditioning is around 90% on a national scale (De Cian et al., 2019), but it varies across regions from north to south. Whereas fewer homes are equipped with cooling systems in Hokkaido, where heating needs are more important, the tropical climate in Okinawa induces a strong demand for air conditioning. Although 80% of the nation's power is produced with fossil fuels (IEA, 2022), some regions use more renewables than others. Each region thus has a specific carbon intensity for power generation depending on the energy mix used by the local power company. We use Japan as a case study to investigate how climate change can influence CO<sub>2</sub> emissions by changing power demand and influencing the carbon intensity of the energy mix. We analyze climate change impacts at national and regional scales and develop regional statistical models to derive monthly and seasonal trends and annual net changes in CO<sub>2</sub> emissions until 2100. These models incorporate the effects of climate change and specific regional socio-economic factors (population, GDP, and environmental policies aiming to decarbonize the energy mix) to project power demand, carbon intensity, and CO<sub>2</sub> emissions. Detailed energy mix and climate data are available homogeneously for all ten regions. Hiruta et al. (2022a) used similar data to develop a method that acquires regional temperature response functions (TRFs) for power demand and investigates the effect of climate change on power demand. Although our method to obtain regional models projecting power demand is similar to Hiruta et al. (2022a), we use more up-to-date climate data for the projections: our climate variables are from the last phase of the CMIP project, CMIP6, instead of CMIP5 for the Hiruta study. Unlike the Hiruta study, we further explore long-term changes in CO<sub>2</sub> emissions that can be caused by changes in power demand and carbon intensity under future climate and socioeconomic scenarios. Our proposed method for modeling power demand, carbon intensity, and CO<sub>2</sub> emissions in Japan is of significant local interest as it has the potential to inform policy and decision-making related to energy production and consumption, as well as inform strategies for reducing greenhouse gas emissions. Furthermore, understanding Japan's specific challenges and opportunities in relation to climate change can also contribute to global efforts to address the issue. As the third largest economy in the world and the 11th most populous country, Japan is a major contributor to global greenhouse gas emissions.

Our study on Japan will not only provide insight into how energy demand and related CO<sub>2</sub> emissions may evolve under climate change in Japan specifically but will also offer valuable insight into the challenges and opportunities facing larger industrialized nations in transitioning to low-carbon economies. The findings of such a study can inform global efforts to mitigate and adapt to climate change by identifying successful strategies and best practices that can be replicated in other countries. Additionally, with its wide range of climates, Japan is an ideal case study for understanding the possible evolution of power demand under different climatic conditions. Section 2 details the data used and the algorithms tested to develop models that simulate power demand and carbon intensity. It also describes the method to calculate CO<sub>2</sub> emissions under three future scenarios: SSP1-2.6, SSP3-7.0, and SSP5-8.5. Section 3

presents the results; it describes the regional relationships between predictive variables and power demand and carbon intensity, details the regional and temporal impact of climate on power demand, carbon intensity, and CO<sub>2</sub> emissions, compares our results to those of Hiruta et al. (2022b) and discusses the relative importance of climate and socioeconomic factors in determining the power demand, carbon intensity, and CO<sub>2</sub> emissions. Section 4 discusses the results under a broader context, including caveats of our study. Section 5 concludes the paper.

## 2. Data and methods

The work presented in this article is built around three main steps (Figure 1): i) model development and selection, ii) projections of power demand and carbon intensity under future climate scenarios, and iii) projections of CO<sub>2</sub> emissions under future climate and socioeconomic scenarios. This section details the datasets needed for the different steps (Table 1), the model development, and the projection stage.


### 2.1. Training Data

We trained a statistical model on climate reanalysis data from the ERA5 project (Muñoz Sabater, 2019) to reproduce the observed daily power demand and carbon intensity for all ten regions. Six raw climate variables were used as predictors: temperature, relative humidity, solar and thermal radiation, wind, and precipitation (Table 1). Those data were downloaded from the Climate Data Store website (CDS 2022) at an hourly time resolution over the period 2016 - 2020 and a spatial resolution of 0.08° T2M, RH, SSRD, STRD, and U hourly values were averaged over days, while TP was summed over days. Finally, all these climate variables were regionally averaged. Five human exposure indices were calculated from these climate variables and also used as predictors: the dew point temperature at which the air is saturated with water vapor (Td), the wet bulb temperature (Tw), which is the lowest temperature to which air can be cooled by water evaporation, the discomfort index, which is often used to calibrate air conditioner (DI), the Humidex (Hx), which explains what the temperature feels like for the human body and the Heat Index (HI), which represents what the combination of temperature and relative humidity feels like for the human body. Equations used to calculate these indices (Thom, 1959; Sohar et al., 1963; Stathopoulou et al., 2005; Epstein and Moran, 2006; Buzan et al., 2014; Maia-Silva et al., 2020) are detailed in supplementary materials (Section S1). We also used the days of the week (DOW) as a proxy for human activity. Each day is assigned a numerical value to quantify its effect in our models: Monday is 0, Tuesday 1,..., and Sunday 6.

**Table 1**

*Current (ERA5 for training) and future (ISIMIP3b for projections) climate data used in our analysis.*

Variable and description	ERA5 name	unit	ISIMIP3b name	unit
Near surface atmospheric temperature (2m above the surface)	T2M	K	TAS	K
Relative Humidity (water vapor pressure as a percentage of the value at which the air becomes saturated)	RH	%	HURS	%
Surface solar radiation downward (amount of shortwave radiation that reaches a horizontal plane at the surface)	SSRD	J.m <sup>-2</sup>	RSDS	W.m <sup>-2</sup>
Surface thermal radiation downward (amount of longwave radiation emitted by the atmosphere and clouds that reaches a horizontal plane at the surface)	STRD	J.m <sup>-2</sup>	RLDS	W.m <sup>-2</sup>
Wind (speed of horizontal wind 10 m above the surface)	U TP	m.s <sup>-1</sup> m	SFCWIND PR	m.s <sup>-1</sup> kg.m <sup>-2</sup> .s <sup>-1</sup>
Precipitation (total amount of water that fall at the surface)				

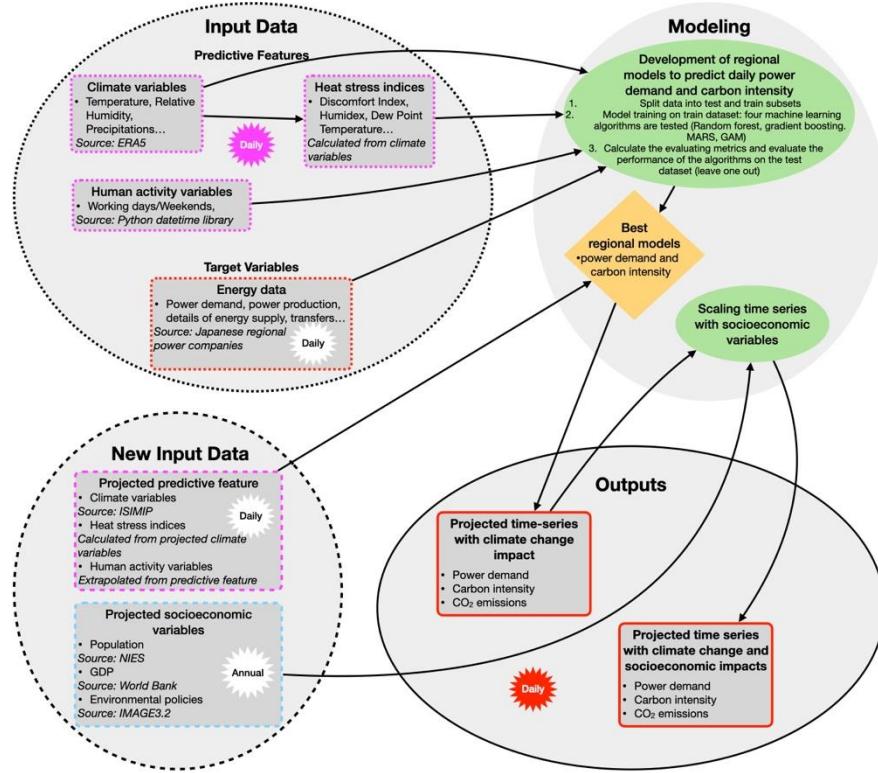

**Figure 1:** Flowchart of the methodological procedures used in this study. Current (ERA5 for training) and future (ISIMIP3b for projections) climate data used in our analysis.

Hourly data for power demand and the energy mix was obtained directly from the website of the ten power utilities (supplementary materials, Section S2). Data have been available since April 2016 and provided for eight types of power supply: fossil, nuclear, photovoltaic, wind, hydroelectricity, geothermal, biomass, and pumped-storage hydroelectricity. The energy mix of each region is detailed in supplementary materials (Section S2, Table S1). Further details on the types of fossil fuel (coal, gas, and oil share) are unavailable at the hourly scale. Still, the Japanese agency for natural resources and energy from the Ministry of Economy, Trade, and Industry (METI) provides monthly

fractions of coal, gas, and oil used in the regional energy mixes from 2017 to 2020. The fossil energy mix is relatively constant over these four years, with approximately 50% of gas, 40% of coal, and 10% of oil. The regional daily carbon intensity of power generation was calculated assuming this ratio constant.

## 2.2. Model development and selection

We tested three non-parametric models of daily power demand and carbon intensity; random forest classifier (Ho, 1995; Breiman, 2001), histogram-based gradient boosting (Friedman, 1999), and Multivariate Adaptive Regression Spline (MARS) (Friedman, 1991). We trained the algorithms for all ten regions with twelve predictors: six climate variables, five human exposure indices, and human activity proxy (DOW), all twelve described in section 2.1. The training dataset represented 75% of the data, and the test dataset accounted for 25%. We evaluated the performances of the algorithms on both datasets using three metrics: the coefficient of determination (R<sup>2</sup>), the Mean Absolute Percentage Error (MAPE), and the Root Mean Square Error (RMSE).

Results are very similar between random forest and MARS, and both algorithms perform better than gradient boosting (Table S2 and Figure S1, Section S3, supplementary materials). As it is faster to optimize random forest hyperparameters, we decided to proceed with this algorithm for the projection stage. Although the methodology used for the model development and selection stage is the same as Hiruta et al. (2022a), we developed our models with a different algorithm and used different evaluation metrics.

We used interpretability methods, including Partial Dependence Plots (PDPs) (Friedman, 2001; Greenwell, 2017) and Shapley values (Roth, 1988; Winter, 2002), to analyze the effect of predictors on our model predictions. These methods can be distinguished into global and local diagnostics:

- Global diagnostics provide insights into the average behavior of the model, thus giving hints on the mechanisms that influence the prediction. PDPs are part of these diagnostics. Such plots illustrate the marginal effect of a single predictor on the model output (here, power demand or carbon intensity). These plots are generated by averaging the lines of Individual Conditional Expectation (ICE) plots. ICE plots represent the prediction changes for each observation as a predictor varies.
- Local diagnostics, such as Shapley values, explain individual predictions of a machine learning model. The Shapley values are interpreted as follows: “Given the current set of feature values, the contribution of a feature value to the difference between the actual prediction and the mean prediction is the estimated Shapley value” (Molnar, 2020). One can interpret Shapley values as a way to represent the probability of an impact of a predictor in the projection; a

negative Shapley value shifts the predicted value in a negative direction, whereas a positive Shapley value shifts it in a positive direction.

PDPs and Shapley values enable the interpretation of the regional models obtained with random, showing how each predictor affects the model outputs. PDPs were calculated from a subsample of fifty observations, and Shapley values were calculated for each observation of each predictor.


### 2.3. Projections

Once the regional models were calibrated for current climate conditions (i.e., the period 2016-2020), we employed them to project the evolution of power demand and carbon intensity under different climate scenarios over 2020-2100 (Figures 2c and 2d). We worked with three scenarios (SSP1-2.6, SSP3-7.0, and SSP5-8.5) and used bias-corrected and statistically downscaled climate projections from the ISIMIP3b simulation round (Lange, 2021) at a daily timescale as predictors. Those data come from five different Earth System Models from the 6th phase of the CMIP project (CMIP6); GFDL-ESM4, IPSL-CM6A-LR, MPI-ESM1-2-HR, MRI-ESM2-0, and UKESM1-0-LL. Figure 2a shows the projected temperatures for all ten regions and three scenarios as an example of the projected climate predictors. We calculated human exposure indices (DI (Figure 2b), Hx, HI, Td, and Tw) from the projected climate predictors. We checked the consistency of ERA5 data and ISMIP projections over the period 2016-2020 and found good compatibility, with ERA5 values in the range of the ISIMIP projections (Figure S2 in the supplementary materials section S5). Finally, we simulated daily climate-induced CO<sub>2</sub> emission projections by multiplying daily power demand and carbon intensity projections.

### 2.4. Socioeconomic scenarios


The last step of our study was to include the impacts of socioeconomic factors on CO<sub>2</sub> emissions for all three SSPs. The Climate Change Adaptation Information Platform from the National Institute for Environmental Studies (NIES), Japan (A-PLAT, 2022), provides population projections at the prefecture scale. We aggregated such projections at the regional scale. Those data predict a decrease in Japan's population in all SSPs (Figure 3a). We obtained regional GDP projections (Figure 3b) by scaling Japan's GDP projections provided by the OECD (Riahi et al., 2017; Dellink et al., 2017) with current ratios between Japan's total GDP and regional GDP. Given the absence of regional GDP projections, we assumed that all regional GDP projections follow the same trend. We calculated Japan's carbon intensity projections (Figure 3c) based on national projections of the IMAGE3.2 model (Van Vuuren et al., 2021). We downscaled the national carbon intensity projection to regional levels with the same methodology as for GDP. Further details can be found in the supplementary material (Section S4). We quantified the individual influence of each factor (climate change, population, GDP, and environmental policies aiming to decarbonize the energy mix) on total CO<sub>2</sub>

emissions by varying one factor at a time. For example, to quantify the individual influence of GDP on total CO<sub>2</sub> emissions over the whole period, we varied only the values of GDP when running the models and we fixed all the other variables (climate, population, and carbon intensity) to their 2016 values.

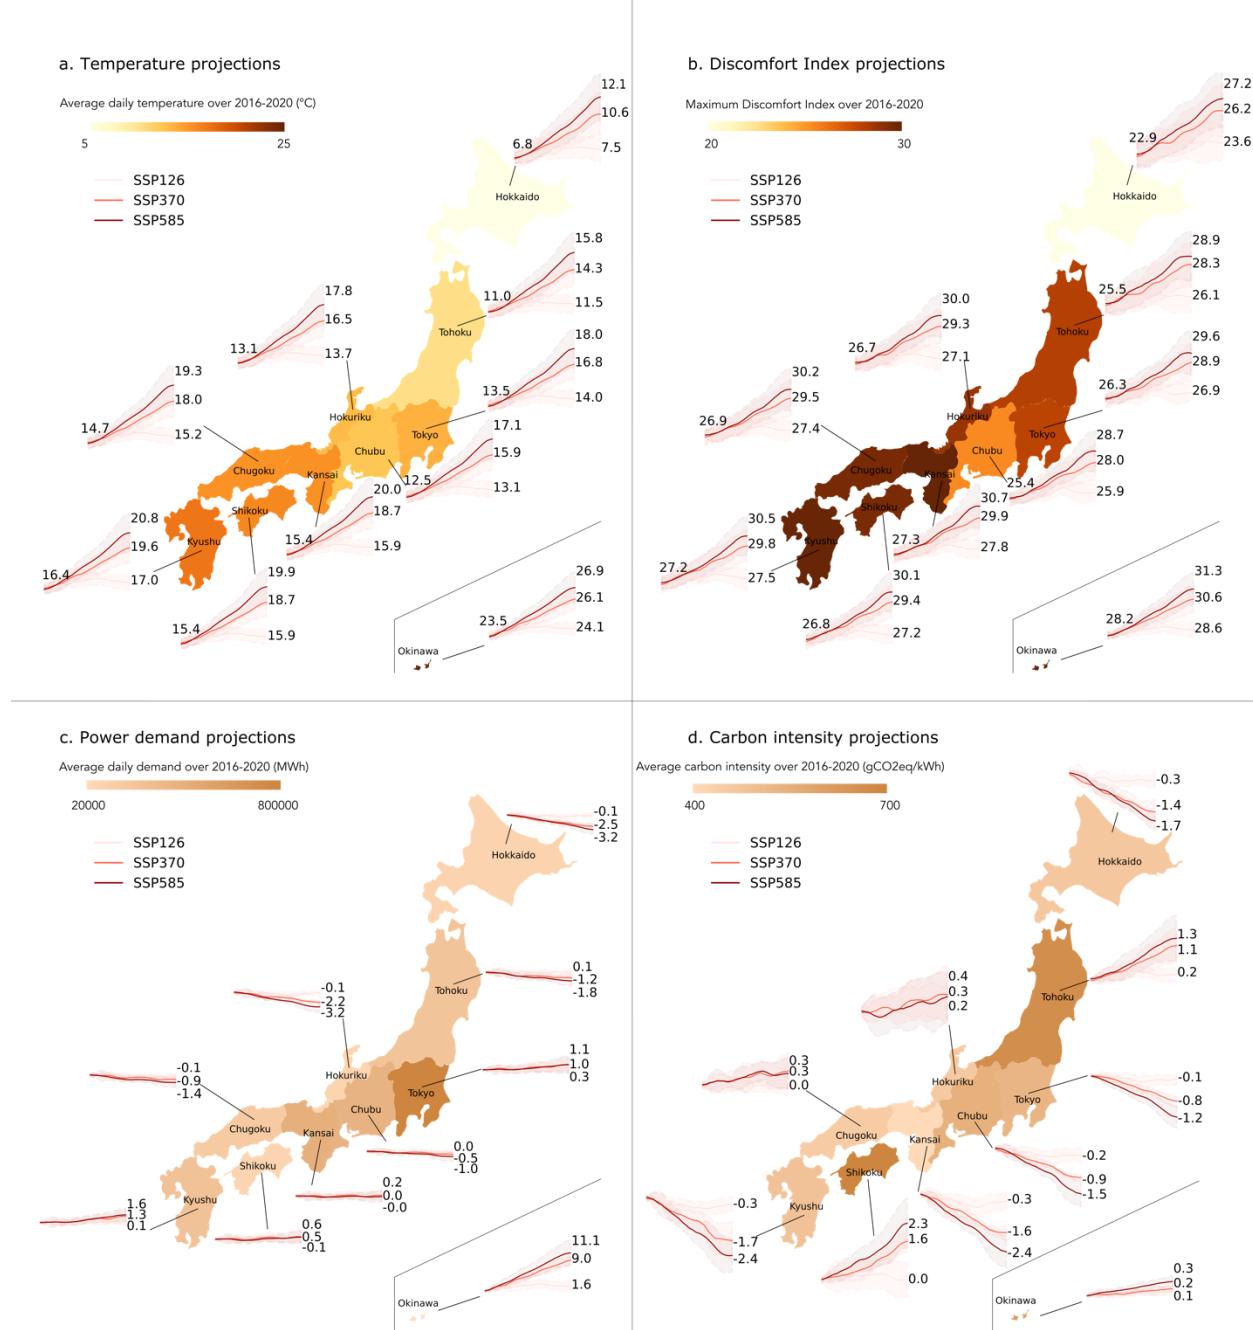

**Figure 2:** Current and future projections under climate change of average daily temperature (a), DI (b), power demand (c), and carbon intensity (d) for the ten regions of Japan. The color scale on the maps indicates the level for the period 2016-2020. Projections for the period 2020-2100 are shown in solid bands. Lines give mean values from five models;


*shaded areas show standard deviations. Future projections in panels c and d are shown in percentage (relative changes to present levels).*

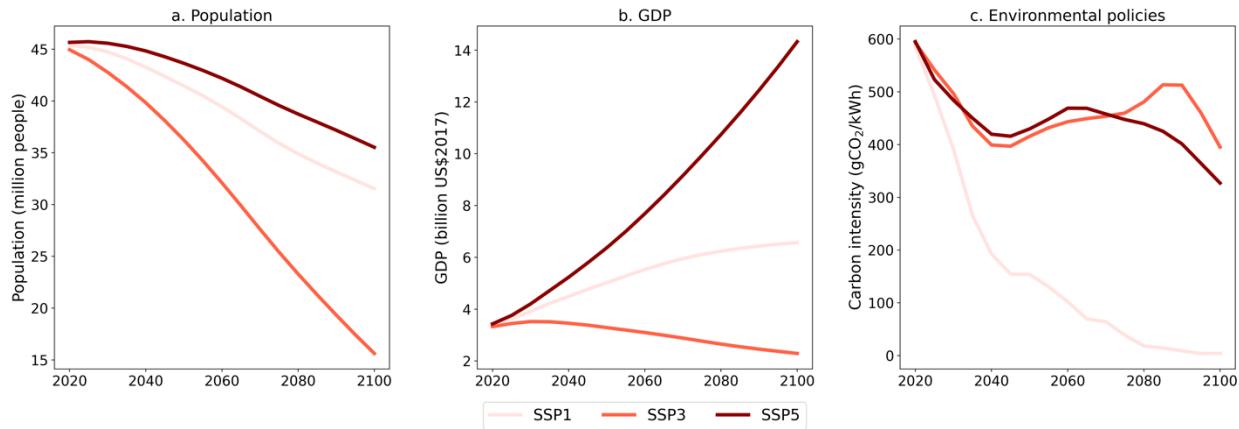

**Figure 3:** Socioeconomic projections of (a) population, (b) GDP, and (c) environmental policies aiming to decarbonize the energy mix used for power generation for the region of Tokyo.

### 3. Results


#### 3.1. Regional models: important features explaining daily power demand and carbon intensity variations in each region

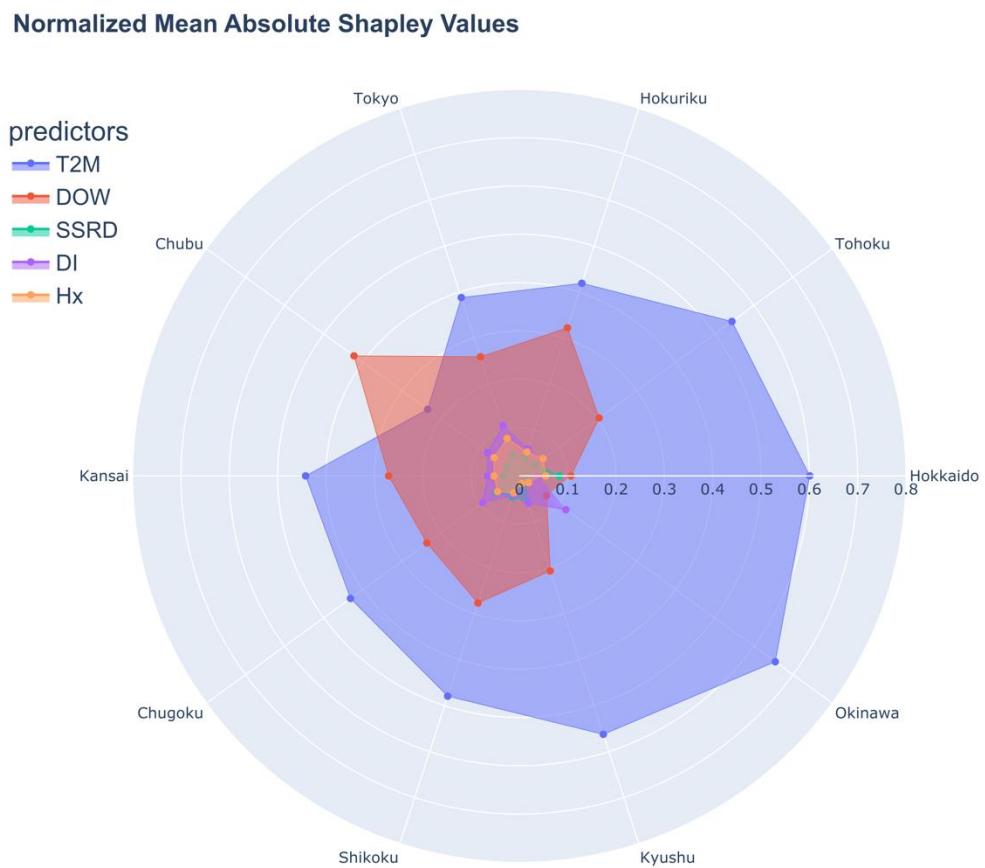

**Figure 4:** Radar plot showing the relative importance of the main predictors explaining power demand across regions (T2M, DOW, SSRD, DI, and Hx - see Table 1), obtained from the normalized mean absolute Shapley values of all observations for each predictor. The relative importance of the predictor is calculated for each region by normalizing the mean absolute Shapley value of every predictor.

We calculated Shapley values for all predictors in all ten regions. Of twelve predictors, five consistently appear among the most important to explain the power demand (Figure 4): the temperature (T2M), the day of the week (DOW), the solar radiation (SSRD), the discomfort index (DI) and the Humidex (Hx). T2M is the most important predictor in all regions except Chubu and Okinawa, followed by DOW. The order between T2M and DOW is reversed in Chubu. DI is the second most important predictor instead of DOW in Okinawa (Figure 4). The third most important predictor varies by region, but in general, it is DI (for six regions).

We looked at the PDPs of the main predictors and the Shapley values (Figures 5 and S3 in the supplementary materials section S6) to better understand the non-linear influence of the predictors in our regional models. For example, with the Tokyo region, the PDP for T2M shows a U-shaped dependency of power demand to temperature (Figure 5a). Two temperature thresholds can be identified: power demand is increasing under 10 °C for heating purposes and above 18 °C for cooling purposes. The power demand is more or less constant between those two temperatures. Shapley values (Figure 5d) show that when temperature values are either high or low (red and blue tones), power demand shifts in a positive direction, thus confirming the behavior observed with the partial dependence plot. The same relationship between temperature and power demand is also observed in several other regions (Figure S3, Section S6, supplementary materials). However, Hokkaido and Okinawa show different relationships. Power demand decreases when the temperature increases in Hokkaido and remains constant above 10°C, suggesting that power demand is controlled only by heating demand. The opposite effect is observed in Okinawa; power demand is constant under 24°C and increases once this temperature is exceeded. The specific regional thresholds triggering power demand for heating or cooling reflect households' structure and population behavior.

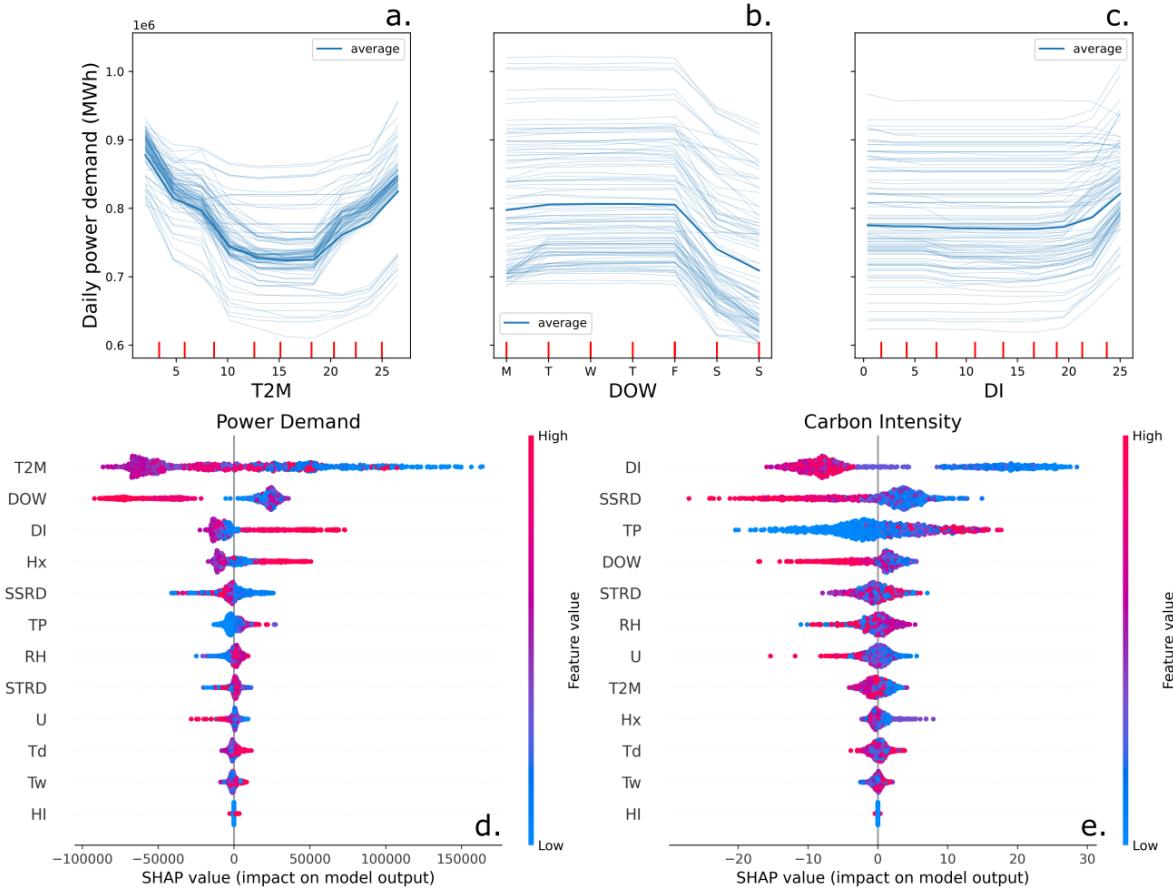

**Figure 5:** Partial dependence plot (thick line) and Individual Conditional Expectation plots (thin lines) for 100 model realizations for three main predictors explaining the power demand for the Tokyo region: air temperature at two meters above ground T2M (a), day of week DOW (b - the letters on the x-axis indicate the days of the week) and discomfort index DI (c). The vertical red bars show the predictor values distribution. The lower panels represent the Shapley values for each predictor for power demand (d) and carbon intensity (e). The figures for the other regions can be found in the supplementary material, section S6.

We also analyzed the dependency of power demand on the days of the week (DOW) with PDP and Shapley Values (Figures 5b and 5d). Power demand is constant from zero to four (Monday to Friday) and decreases above four, reflecting a lower demand during weekends. Figure 5d highlights the clear separation between weekends and working days. The same relationship is observed for all regions, although the impact of weekends on power demand is larger in Chubu (Figure S2e and Figure 4).

Finally, we analyzed the relationship between the DI and power demand (Figures 5c and 5d). Power demand increases when the threshold of 21 is exceeded. This behavior is observed for all regions having the DI as one of the three most


influential predictors (Figure S3, supplementary material). Previous studies identified 21 as the threshold above which people start to feel heat stress (Thom, 1959; Stathopoulou et al., 2005), and DI is often used to calibrate air conditioners (Sohar et al., 1963; Epstein and Moran, 2006; Buzan et al., 2014; Maia-Silva et al., 2020), explaining such behavior.

We analyzed the relationships between carbon intensity and all 12 predictors with Shapley values (Figure 5e). In the example of Tokyo, DI is the most important predictor. It positively shifts carbon intensity predictions when the predictor values are low, meaning that more fossil fuels are used for power generation when DI is low. Surface solar radiation downward (SSRD) is the second most important predictor. SSRD negatively shifts carbon intensity predictions when the SSRD value is high, probably because solar panels more easily exploit solar energy under a clear sky with much incoming solar radiation than under a cloudy condition. It should be noted that too strong solar radiation can inhibit the efficiency of power production from solar panels. Precipitation (TP) has the opposite effect. Carbon intensity predictions are shifted positively when TP is important, meaning less use is made of renewable energies. The order of importance of predictors for carbon intensity predictions varies more across regions than for power demand. However, more climate predictors are among the most important predictors, reflecting the dependency of the daily variability of the renewable energy capacity on the daily weather.

### 3.2. Impact of future climate change on power demand, carbon intensity, and CO<sub>2</sub> emissions

Power demand projections for all ten regions and three scenarios (Figure 2c, Section 2) show that climate change's impact on power demand differs between regions throughout the century. Such projections show a warming-induced decrease in power demand under SSP3-7.0 and SSP5-8.5 in most regions (up to -3.2% in Hokkaido and Hokuriku). However, the projections reveal a net increase in the daily power demand in Okinawa and Kyushu, the two hottest regions (Figure 2a, Section 2). This increase is up to 1.6% in Kyushu and is even more pronounced in Okinawa (+1.6% for SSP1-2.6 and +11.1% for SSP5-8.5). Changes in the power demand across regions (except Okinawa) under SSP1-2.6 are small, ranging from -0.1 to 0.5%. Such results indicate that a decrease in the power demand in winter under future warming leads to an annual decrease in power demand in cold regions like Hokkaido. However, this possible decrease in winter power demand is overcompensated by a summer increase in hot regions such as Okinawa or Kyushu, leading to an annual increase. Climate change's impact on carbon intensity also varies across regions (Figure 2d), but results are less significant than for power demand. Carbon intensity projections are less accurately simulated by our models (higher RMSE and lower R<sup>2</sup>). Nevertheless, the projections show that most regions see their carbon intensity negatively affected by climate change. Tohoku and Shikoku, the regions with the highest average carbon intensity (roughly 600 gCO<sub>2</sub>eq/kWh), are the only regions showing a climate-induced increase in carbon intensity under SSP3-7.0 and SSP5-8.5 (+1.3% and +2.3%, respectively). For Chugoku, Hokuriku, and Okinawa, the projected changes in carbon intensity are small and within the models' error range.

Figure 6 shows how the influence of climate change on power demand and carbon intensity translates into carbon emissions. In the "no climate change scenario" (plain line), climate variables were held constant at their 2016 values. Therefore, are only influenced by changes in population, GDP, and carbon intensity. In the "climate change scenario" (dashed line), we varied all four factors (climate, population, GDP, and carbon intensity) with time. Climate variables values varied according to the ISIMIP projection, and socioeconomic variables according to the projection presented in Figure 3. The difference between the solid and dashed lines for each region and scenario represents the difference in emissions due to climate change alone. In Figure 6, we show the results of four regions. Results for the other regions are displayed in Figure S4 (Section S7, supplementary material). The regions with the most extreme temperatures (Hokkaido and Okinawa) indicate the largest differences. Climate change leads to a decrease in CO<sub>2</sub> emissions in Hokkaido but an increase in Okinawa. Okinawa and Shikoku are the only regions with higher emissions from climate change. The power demand is projected to increase strongly in Okinawa, especially under SSP5-8.5, which explains an increase in CO<sub>2</sub> emissions. On the other hand, the CO<sub>2</sub> emissions increase in Shikoku is due to an increase in carbon intensity simulated by the model. In all other regions, climate change leads to an increase in CO<sub>2</sub> emissions. In Kyushu, the CO<sub>2</sub> emissions decrease with climate change because the decline in carbon intensity takes over the increase in power demand. Such an effect can also be found in the Tokyo region, albeit to a lesser extent.

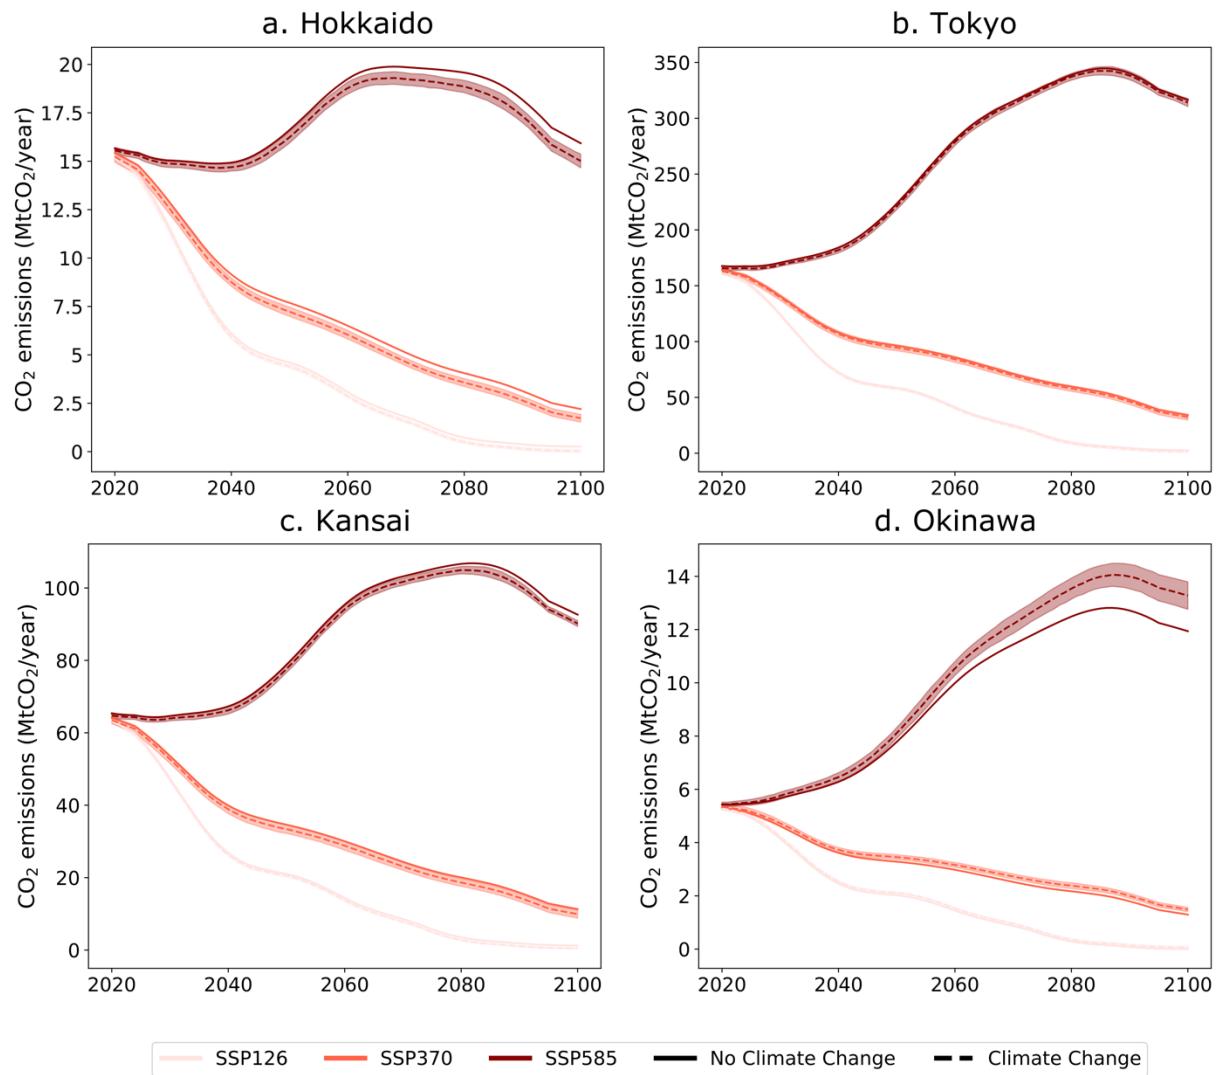


**Figure 6:** Annual CO<sub>2</sub> emissions from power generation under SSP1-2.6, SSP3-7.0, and SSP5-8.5, after considering socioeconomic impacts with (dashed line) and without (solid line) climate change impact for four regions: Hokkaido (a), Tokyo (b), Kansai (c) and Okinawa (d). The shaded area represents the 1-sigma standard deviation from the five climate models for the scenario considering climate change impact (dashed line).

### 3.3. Attribution of the changes in power demand and CO<sub>2</sub> emissions

This section analyzes the effect of seasons and hot and cold periods on power demand and their respective contributions to the total annual change in power demand between 2020-2030 and 2090-2100. We divided days into four categories (cold, cool, warm, and hot) based on temperature distributions during 2016-2020. We calculated the number of days in each category under the three SSPs during 2020- 2030 and 2090-2100. We attributed the

contribution of the change in power demand in each category to the total change in power demand (Figure S6, section S8, supplementary material). The number of hot days increases in all ten regions. Increasing power demand during hot days is associated with cooling demand. However, such an increase is counterbalanced by a decrease in power demand in other categories of days. Okinawa is an exception; power demand increases in all categories of days.

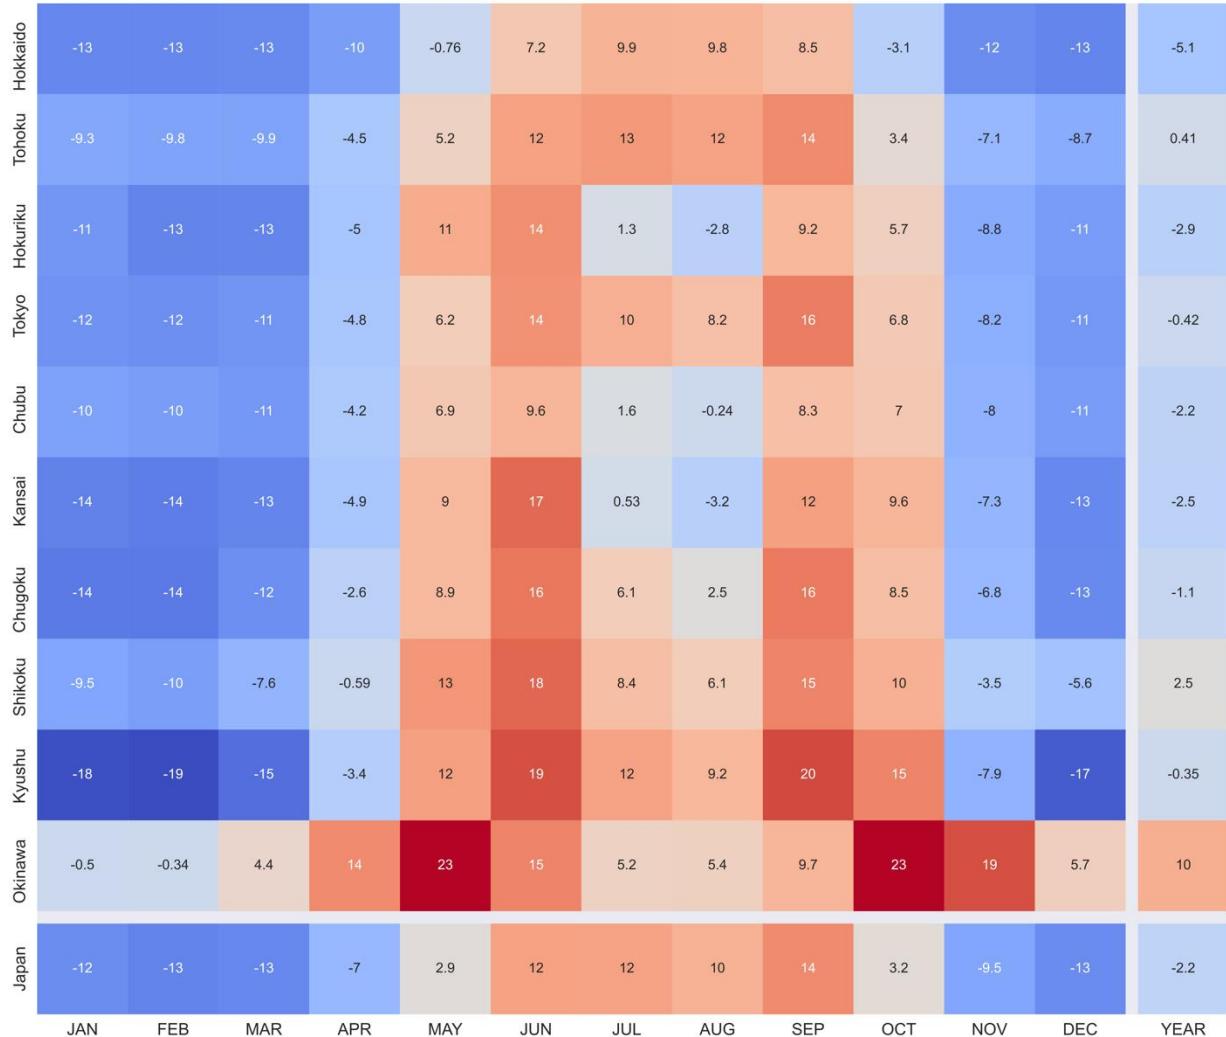

**Figure 7: Monthly and regional changes (in percentage) in CO<sub>2</sub> emissions between the decade 2020-2030 and 2090-2100 due to climate impacts on future power demand. The mean results of the five models for SSP5-8.5 are shown.**

Figure 7 shows the changes in CO<sub>2</sub> emissions between 2020-2030 and 2090-2100 due to changes in power demand and carbon intensity under SSP5-8.5 at monthly and regional levels. This figure allows for comparing our results with those of Hiruta et al. (2022b) (see Section 4 for the comparison). Most regions are projected to see a decrease in annual CO<sub>2</sub> emissions from power generation due to climate change, ranging from -0.3% to -5.1%. Shikoku and Okinawa are

exceptions; their CO<sub>2</sub> emissions are projected to increase by 2.5 and 10%, respectively. Larger differences emerge at the monthly scale; the largest increases in CO<sub>2</sub> emissions (up to 23% increase in Okinawa) occur during a few transition months before and after the hottest months (i.e., May, June, September, and October) for all regions except Hokkaido and Tohoku. The largest increases occur during the warmest months in these two relatively cold regions. Such results indicate that the "next-warmest months" (May, June, September, and October) are most susceptible to future climate. A threshold temperature above which the demand for air conditioning starts was identified for each region in section 3.1 with partial dependence plots. Building on that, we formulate a possible explanation for the observed monthly changes; during July and August, the threshold temperatures triggering cooling demand are already exceeded for most days in all regions (except in Hokkaido and Tohoku). Thus, a further increase in power demand for cooling demand is not expected. However, with future warming, the temperature thresholds could be exceeded earlier in the year (in May or June) and longer (until September or October), explaining why the largest increase in power demand is projected to occur in the "next-warmest months". Similar monthly changes are observed for power demand but not for carbon intensity (Figures S7a and S7b, Section S9, supplementary material), indicating that monthly changes in regional CO<sub>2</sub> emissions are driven more by power demand than carbon intensity.

### 3.4. Comparison of different factors influencing CO<sub>2</sub> emissions of power generation


Figure 8 compares the impact of climate change on CO<sub>2</sub> emissions from power generation with those of socioeconomic factors (population, GDP, and carbon intensity). We quantified the amount of CO<sub>2</sub> emitted by each factor individually by varying one factor at a time. Note that the total in Figure 8 is the arithmetic sum of the individual changes from each factor, which is different from the total (with climate change) in Figure 6, calculated from the compounded change from all factors. With such a method, the results show that climate change plays a minor role in determining future changes in CO<sub>2</sub> emissions (Figure 8). The decreasing population under all scenarios negatively affects CO<sub>2</sub> emissions in all ten regions. GDP influences emissions in different directions according to scenarios; the GDP effect is negative under SSP3-7.0 due to projected GDP decrease, whereas it is positive under SSP1-2.6 and SSP5-8.5 as GDP grows. Under SSP5-8.5, GDP is by far the most important factor determining CO<sub>2</sub> emissions in all ten regions. The effect of carbon intensity on CO<sub>2</sub> emissions is small under SSP5-8.5 and SSP3-7.0, as carbon intensity is not projected to decrease much in these scenarios. However, carbon intensity is the most important factor under SSP1-2.6, leading to a decrease in CO<sub>2</sub> emissions in most regions.

To summarize, when individual effects of climate, population, GDP, and carbon intensity on CO<sub>2</sub> emissions are considered separately, as in Figure 8, the climatic factor is overshadowed by the other factors. However, Figure 6 shows that climate change may have a significant impact when all factors are combined to project CO<sub>2</sub> emissions in certain regions under SSP5-8.5. The importance of the climate change impact on CO<sub>2</sub> emissions depends on the type

of climate of the region and future climate scenarios; it also depends on the month of the year, as indicated in Figure 7.

## 4. Discussion

Our methodology allows for establishing regional statistical models that adequately reproduce the observations of daily power demand and carbon intensity. Seasonal cycles are well captured by the models for power demand, just as intra-weekly cycles (i.e., the distinction between working days and weekends). Interpretation methods such as partial dependence plots and Shapley values gave insights into understanding underlying mechanisms that control the dependency of power demand and carbon intensity on the predictors. As we are able to understand the impact of predictors on the outputs based on underlying mechanisms, such methods give us confidence in the projections of power demand and carbon intensity obtained using these models. Nevertheless, the models' inherent error is important for carbon intensity.

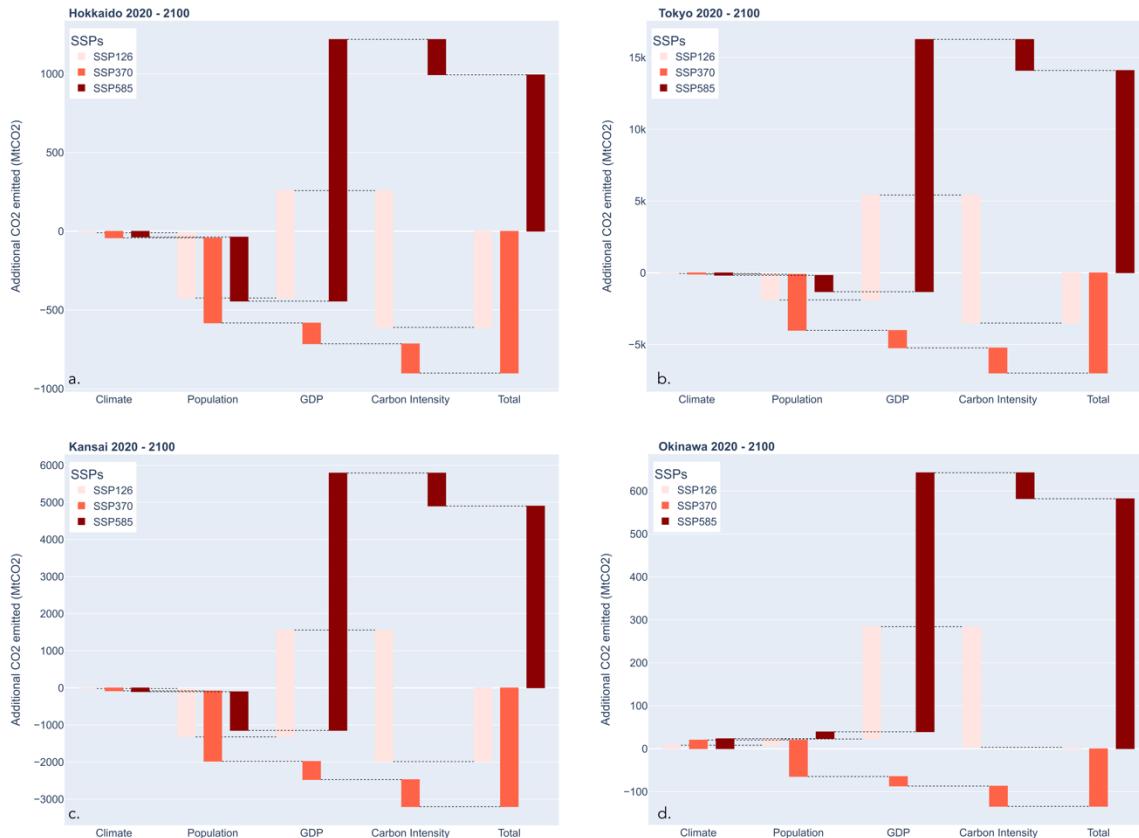

**Figure 8:** Individual contributions of changes in climate, population, GDP, and environmental policies to the changes in total CO<sub>2</sub> emissions of power generation over the period 2020-2100. The figure shows the change in CO<sub>2</sub> emissions due to each factor relative to the level with all other factors kept at current values. The figure shows the results for four representative regions from north to south: Hokkaido (a), Tokyo (b), Kansai (c), and Okinawa (d).

A well-known default of machine learning models is their bad performance outside their calibration range. For the projection, we calculated the percentage of days that have an average daily temperature outside the training temperature range period: 0.8% for SSP1-2.6, 3.6% for SSP3-7.0, and 5.2% for SSP5-8.5. For the projection period, we argue that the percentage of days with an average temperature outside the training range is small enough to avoid overfitting.

Hiruta et al. used a comparable methodology (Hiruta et al., 2022a) and also projected regional power demand in Japan with statistical models (Hiruta et al., 2022b). However, we went one step further by modeling the influence of climate on carbon intensity and, eventually, CO<sub>2</sub> emissions. We obtained similar results for regional power demand; a decrease in power demand in cold regions and an increase in hot regions. However, we found a maximal increase in power demand during "next-warmest months" (May, June, September, and October). In contrast, the Hiruta study found it during the warmest months (July and August). This difference between the two studies has important implications for the power grid infrastructure in the future. Projecting the future power demand for air conditioning under changing climate is a critical issue in Japan, as revealed by the power supply situation in the summer of 2022. At the end of June 2022, Japan experienced a serious power deficit during weeks unusually hot for this month but not during equally hot weeks in July or August. The power deficit occurred in June as some thermal power plants were under periodic inspection before the high season and were not being operated (METI 2022). With climate change, there will be an increased risk of having peak demand earlier in the season. Power companies will have to consider it to avoid the problems of June 2022 happening again.

Here we discuss factors that can influence power demand but are not considered in our study. Firstly, the Urban Heat Island effect (UHI) is known to influence power demand. UHI amplifies power demand for air conditioning in densely populated cities in hot regions while it translates into a decrease in the demand for heating in colder regions (Xiaoma et al., 2019; Roxon et al., 2020). Xiaoma et al. (2019) showed that the UHI effect could increase the need for cooling energy by 19% and decrease the need for heating by 18.7% on average. According to the World Bank, 90% of the population lives in urban areas in Japan, with 60% of the country's 126 million inhabitants concentrated in the metropolitan areas of Tokyo, Nagoya, and Osaka. Hence, the UHI effect is probably not negligible and translates into a warming that is already a few degrees higher in cities than in rural areas (Takane et al., 2014; Takaya et al., 2014).

The earth system models that generated the climate data we used for projection do not resolve UHI, implying that the future power demand in our projections may be underestimated in densely populated regions.

Secondly, a study by De Cian et al. (2019) predicts that almost 100% of Japanese homes will adopt air conditioning by mid-century for all scenarios. Even though Japan is already among the countries with the highest air conditioning adoption rate per household, about 90% nationwide in 2011 (De Cian et al., 2019), the effect of increased access to air conditioning was not taken into account in our model. Such an increase could boost power demand if all other factors, such as the efficiency of air conditioning and the housing insulation, are kept the same. Specifically, it could significantly change the climate response functions for power demand in cold regions like Hokkaido as, for now, these regions have fewer houses equipped with cooling systems compared to the rest of the country. However, with our methodology, there is not enough data to model the power demand linked to air conditioner usage in such regions.

Thirdly, human exposure indices use thresholds to account for the level of heat stress felt by the population. For the DI, there is no discomfort below 21; between 21 and 24, less than 50% of the population feels discomfort; between 24 and 27, more than 50% of the population feels discomfort; between 27 and 29, most of the population suffers discomfort; between 29 and 32, everyone feels severe stress; above 32, the state of medical emergency is reached (Stathopoulou et al., 2005). Figure 2b shows the projection for the annual maximal DI. The threshold of 24 has never been exceeded in Hokkaido for now. By the end of the century, DI could reach 27 in Hokkaido (Figure 2b). The maximal DI was 28 in Okinawa in 2020. At the end of the century, it could reach the dangerous threshold of 32. Exceeding such thresholds may lead to an underestimation of the power demand for air conditioning in all regions because there is no data to calibrate human behavior regarding the use of air conditioning when these thresholds are exceeded.

Finally, while our machine learning models developed to simulate the response of power demand to future climate are elaborated, how power demand responds to the future evolution of socioeconomic variables is modeled in a simpler way. Similarly, while we used projections of climate variables with a rather high spatial resolution (CMIP6 data, widely used in the scientific community), the projections used for the socioeconomic variables were only at the national scale for GDP and carbon intensity. Given the data availability, there are differences in the spatial and temporal resolutions of climate and socioeconomic data used in our analysis, which might have affected the accuracy of power demand projections from our model.

In conclusion, our study on Japan has revealed two key findings. The first pertains to the local impact of climate change and highlights the potential for increased power outages and grid saturation during the "next-warmest months" in Japan. The second finding is of global significance and demonstrates the usefulness of Japan as a case study to develop and test a methodology for assessing the evolution of power demand and CO<sub>2</sub> emissions under the influence of climate change. The selection of Japan as a case study was motivated by its diverse range of climates,

which can be representative of various regions of the world and provide insight into potential variations in power demand. Based on the findings from our research, which examined various regions in Japan, it is projected that there will be a decline in demand in cold and temperate regions and an increase in tropical regions. This outcome aligns with previous studies using different modeling methods, such as the research conducted by Van Ruijven et al. (2019), which examined the evolution of energy demand on a global scale.

## CRediT authorship contribution statement

**Léna Gurriaran:** Conceptualization of this study, Methodology, Software, Formal analysis, Writing - Original draft preparation. **Katsumasa Tanaka:** Conceptualization, Writing- Reviewing and Editing. **Kiyoshi Takahashi:** Writing-Reviewing and Editing. **Philippe Ciais:** Conceptualization, Writing- Reviewing and Editing.

## Acknowledgement

Katsumasa Tanaka benefited from State assistance managed by the National Research Agency in France under the Programme d'Investissements d'Avenir under the reference ANR-19-MPGA-0008.

During the preparation of this work, the author(s) used ChatGPT in order to enhance the clarity and coherence of the text when deemed necessary. After using this tool/service, the author(s) reviewed and edited the content as needed and take(s) full responsibility for the content of the publication.

## References

- Friedman, J.H., 2001. Greedy function approximation: A gradient boosting machine. *The Annals of Statistics* 29, 1189–1232. URL: <http://www.jstor.org/stable/2699986>.
- Andrijevic, M., 2021. Future cooling gap in shared socioeconomic path- ways. *Environmental Research Letters* 16, 0940553. doi:10.1088/1748-9326/ac2195.
- Roth, A.E., 1988. Introduction to the shapley value. *The Shapley value* , 1–27.
- Auhammer, M., Baylis, P., Hausman, C.H., 2017. Climate change is projected to have severe impacts on the frequency and intensity of peak electricity demand across the united states. *Proceedings of the National Academy of Sciences* 114, 1886–1891. doi:10.1073/pnas.1613193114.
- Roxon, J., Ulm, F.J., Pellenq, R., 2020. Urban heat island impact on state residential energy cost and co2 emissions in the united states. *Urban Climate* 31, 100546. doi:10.1016/j.uclim.2019.100546.
- Breiman, L., 2001. Random forests. *Machine Learning* 45, 5–32. doi:10.1023/A:1010933404324.

Sohar, E., Adar, R., Kaly, L., 1963. Comparison of the environmental heat load in various part of israel. Bulletin of the Research Council of Israel 10, 111–115.

Buzan, J.R., Oleson, K., Huber, M., 2014. Implementation and comparison of a suite of heat stress metrics within the community land model version 4.5. *Geoscientific Model Development Discussions* 7, 5197– 5248. doi:10.5194/gmdd-7-5197-2014.

Stathopoulou, M., Cartalis, C., Keramitsoglou, I., Santamouris, M., 2005. Thermal remote sensing of thom's discomfort index (di): Comparison with in situ measurements, in: Proc SPIE, pp. 131–139. doi:10.1117/12.627541.

De Cian, E., Pavanello, F., Randazzo, T., Mistry, M., Davide, M., 2019. Householdsadaptation in a warming climate: Air conditioning and thermal insulation choices. *Environmental Science & Policy* 100, 136–157. doi:10.1016/j.envsci.2019.06.015.

Takane, Y., Kusaka, H., Kondo, H., 2014. Investigation of a recent extreme high-temperature event in the tokyo metropolitan area using numerical simulations: the potential role of a 'hybrid' foehn wind. *Q. J. R. Meteorol. Soc.* doi:10.1002/qj.2490.

Dellink, R., Chateau, J., Lanzi, E., Magné, B., 2017. Long-term economic growth projections in the shared socioeconomic pathways. *Global Environmental Change* 42, 200–214. doi:10.1016/j.gloenvcha.2016.06.012.

Takaya, A., Morioka, Y., Behera, S.K., 2014. Role of climate variability in the heatstroke death rates of kanto region in japan. *Scientific Reports* doi:10.1038/srep05655.

Epstein, Y., Moran, D.S., 2006. Thermal comfort and heat stress indices. *Industrial Health* 44, 388–398. doi:<https://doi.org/10.2486/indhealth.44.388>.

Van Ruijven, B., De Cian, E., Wing, I., 2019. Amplification of future energy demand growth due to climate change. *Nature Communications* 10, 2762. doi:10.1038/s41467-019-10399-3.

Friedman, J., 1991. Multivariate adaptive regression splines. *Annals of Statistics* 19, 1–67. doi:10.1214/aos/1176347963.

Van Vuuren, D., Stehfest, E., Gernaat, D., et al., 2021. The 2021 SSP scenarios of the IMAGE3.2 model. Technical Report 4740. PBL Netherlands Environmental Assessment Agency. doi:10.31223/X5CG92.

Friedman, J., 1999. Stochastic gradient boosting. *Computational Statistics and Data Analysis* 38, 367–378. doi:10.1016/S0167-9473(01)00065-2.

## Short Title of the Article

Greenwell, B.M., 2017. pdp: an r package for constructing partial dependence plots. *R J.* 9, 421.

Gurriaran, L., Tanaka, K., Bayram, I.S., Proestos, Y., Lelieveld, J., Ciais, P., 2023. Warming-induced increase in power demand and co2 emissions in qatar and the middle east. *Journal of Cleaner Production* 382, 135359. URL: <https://www.sciencedirect.com/science/article/pii/S0959652622049332>, doi:<https://doi.org/10.1016/j.jclepro.2022.135359>.

Hiruta, Y., Gao, L., Ashina, S., 2022a. A novel method for acquiring rigorous temperature response functions for electricity demand at a regional scale. *Science of the Total Environment* 819, 152893. doi:10.1016/j.scitotenv.2021.152893.

Hiruta, Y., Ishizaki, N.N., Ashina, S., Takahashi, K., 2022b. Regional and temporal variations in the impacts of future climate change on japanese electricity demand: Simultaneous interactions among multiple factors considered. Energy Conversion and Management: X 14, 100172. doi:10.1016/j.ecmx.2021.100172.

Ho, T.K., 1995. Random decision forests, in: Proceedings of the 3rd International Conference on Document Analysis and Recognition, pp. 278–282. doi:10.1109/ICDAR.1995.598994.

Lange, S., 2021. ISIMIP3b bias adjustment fact sheet contents. [On- line]. Available: [https://www.isimip.org/documents/413/ISIMIP3b\\_bias\\_adjustment\\_fact\\_sheet\\_Gnsz7CO.pdf](https://www.isimip.org/documents/413/ISIMIP3b_bias_adjustment_fact_sheet_Gnsz7CO.pdf).

Maia-Silva, D., Kumar, R., Nateghi, R., 2020. The critical role of humidity in modeling summer electricity demand across the united states. Nature Communications 11, 1686. doi:10.1038/s41467-020-15393-8.

Molnar, C., 2020. Interpretable Machine Learning. lulu.com.

Mora, C.e.a., 2017. Global risk of deadly heat. Nature Climate Change 7,

501–506. doi:10.1038/NCLIMATE3322.

Patel, L., 2022. Climate change and extreme heat events: How health

systems should prepare. NEJM Catalyst Innovations in Care Delivery

3. <Https://doi.org/10.1056/CAT.21.0454>.

Riahi, K., van Vuuren, D., Kriegler, E., Edmonds, J., O'Neill, B., Fujimori,

S., Bauer, N., Calvin, K., Dellink, R., Fricko, O., et al., 2017. The shared socioeconomic pathways and their energy, land use, and greenhouse gas emissions implications: An overview. Global Environmental Change 42, 153–168.

Thom, E., 1959. The discomfort index. Weatherwise 12, 57–61. doi:10.1080/00431672.1959.9926960.

L Gurriaran et al.: *Preprint submitted to Elsevier*

Page 13 of 14

Winter, E., 2002. The shapley value. Handbook of game theory with economic applications 3, 2025–2054.

Xiaoma, L., Yuyu, Z., Sha, Y., Gensuo, J., Huidong, L., Wenliang, L., 2019. Urban heat island impacts on building energy consumption: a review of approaches and findings. Energy 174, 407–419. doi:10.1016/j.energy.2019.02.183.

Yalew, S., van Vliet, M., Gernaat, D., Ludwig, F., 2020. Impacts of climate change on energy systems in global and regional scenarios. Nature Energy 5, 794–802. doi:10.1038/s41560-020-0664-z.

Zittis, G., 2021. Business-as-usual will lead to super and ultra-extreme heatwaves in the middle east and north africa. Climate and Atmospheric Science 4, 20. doi:10.1038/s41612-021-00178-7.

Variable and description	ERA5		ISIMIP3b	
	name	unit	name	unit
Near surface atmospheric temperature (2m above the surface)	T2M	K	TAS	K
Relative Humidity (water vapor pressure as a percentage of the values at which the air becomes saturated)	RH	%	HURS	%
Surface solar radiation downward (amount of shortwave radiation that reaches a horizontal plane at the surface)	SSRD	J.m <sup>-2</sup>	RSDS	W.m <sup>-2</sup>
Surface thermal radiation downward (amount of longwave radiation emitted by the atmosphere and clouds that reaches a horizontal plane at the surface)	STRD	J.m <sup>-2</sup>	RLDS	W.m <sup>-2</sup>
Wind (speed of horizontal wind 10m above the surface)	U	m.s <sup>-1</sup>	SFCWIND	m.s <sup>-1</sup>
Precipitation (total amount of water that fall at the surface)	TP	m	PR	kg.m <sup>-2</sup> .s <sup>-1</sup>

- Climate change affects power demand, carbon intensity, and CO<sub>2</sub> emissions.
- Regional data-based models were developed for Japan to project power demand, carbon intensity, and CO<sub>2</sub> emissions under different scenarios until 2100.
- Seasonal and regional disparities were found in the response of power demand to climate change.
- The effect of socioeconomic factors such as population, GDP, and environmental policies was accounted for.

**Declaration of interests**

- The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.
- The authors declare the following financial interests/personal relationships which may be considered as potential competing interests: