



HAL
open science

A reverse method for the determination of the radiological inventory of irradiated graphite at reactor scale

Gregory Nicaise, Bernard Poncet

► **To cite this version:**

Gregory Nicaise, Bernard Poncet. A reverse method for the determination of the radiological inventory of irradiated graphite at reactor scale. EUROSAFE FORUM 2015, European Technical Safety Organisations Network, Nov 2015, Brussels (Belgium), Belgium. hal-04258535

HAL Id: hal-04258535

<https://hal.science/hal-04258535>

Submitted on 25 Oct 2023

HAL is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.



Distributed under a Creative Commons Attribution - NonCommercial - NoDerivatives 4.0 International License

A reverse method for the determination of the radiological inventory of irradiated graphite at reactor scale

Grégory Nicaise*, Bernard Poncet**

*Institut de Radioprotection et de Sûreté Nucléaire, 31, avenue de la Division Leclerc 92260 Fontenay-aux-roses, France

** EDF CIDEN, 154 Avenue Thiers, CS 60018, 69458 Lyon cedex 06, France

Abstract:

About 17,000 tons of irradiated graphite waste will be produced from the decommissioning of the six gas-cooled nuclear reactors operated by Electricité De France company (EDF), a French energetic utility.

Determining the radionuclide content of this waste is an important in order to determine the best suited management strategy. As evidenced by numerous studies nuclear graphite is a very pure material, however, it cannot be considered from an analytical viewpoint as a usual homogeneous material.

Because of graphite high purity, radionuclide measurements in irradiated graphite exhibit very high discrepancies especially when corresponding to precursors at trace level. Therefore the assessment of a radionuclide inventory only based on few number of radiochemical measurements leads in most of cases to a gross over or under-estimation of radionuclide inventory. A reverse method using an identification calculation–measurement process is proposed by EDF in order to assess the radionuclide inventory as precisely as possible. A physical interpretation of the results is performed by Institut de Radioprotection et de Sûreté Nucléaire (IRSN), and first elements of validation of the proposed reverse method are given in this paper.

1. GRAPHITE WASTE MANAGEMENT AND RADIONUCLIDE INVENTORY

Electricité De France (EDF) operated six gas-cooled reactors in France, all now shutdown for at least 15 years. These reactors are called in French, “uranium naturel graphite gaz” reactor type (UNGG). They were graphite moderated, cooled by carbon dioxide and fuelled with metallic natural uranium. Dismantling of UNGG reactors is expected to start in 2025 with the removal of the first graphite blocks from the Bugey 1 pile according to the most recent planning.

The design of UNGG reactors is, in principle, very close to that of the British Magnox reactors that were developed independently at the same period in United Kingdom. In the absence of uranium enrichment, graphite was used as a moderating material with a very high level of purity due to the necessity of the highest neutron transparency (nuclear purity). Graphite was also chosen as a mechanical support of the fuel cartridges (graphite sleeves) and as a biological shielding in some reactors. The irradiated graphite blocks from the pile or from the biological shielding still lies in the reactors. The graphite sleeves that are not already shipped to the Centre de Stockage de l’Aube (surface repository in France) are stored in silos. The total amount of irradiated graphite for EDF UNGG reactors is about 17,000 tons. It consists of 13,000 tons of graphite blocks from the piles of the six UNGG reactors, 2,000 tons of graphite sleeves in silos and 2,000 tons of graphite used as biological shielding in “integrated vessel” type reactors.

For safety reasons, it is essential that the waste producer assesses the radionuclide inventory of the graphite. For dismantling purposes the radionuclide inventory is needed in order to choose the most suitable deconstruction tools and the radiological shielding to ensure the safety of the staff. As the behaviour of radionuclides may lead to significant discharges under dismantling conditions, radionuclide identification makes it possible to adapt the confinement and purification systems in order to limit the impact on the environment.

The inventory knowledge is an input data in the definition of the most suitable disposal stream. The radionuclide inventory declaration is the result of a rigorous procedure in accordance with the laws of physics, based on results of samples analysis and on calculations seeking to best reproduce the phenomena explaining the radionuclide presence. Sometimes in the absence of any quantifiable element, the result may be based on reasoned choices to ensure a reasonably achievable over-assessment of the radionuclide inventory to be declared by the graphite waste producer. With the improvement of analytical techniques and with the enhancement of accessible data through the implementation of new sampling and measurement campaigns, the radionuclide inventory of graphite can be made more precise in order to be as close as possible to reality for assessing safety of disposal.

This paper shows that the usual way used to assess the radionuclide inventory based on activation calculations of assumed impurity content in the graphite does not fit at all for the graphite from UNGG reactors. Most of the time, the impurity content of the graphite is not well known or actually unknown, remaining below the limit of chemical detection. A mathematical methodology, coupling computation tools and radiochemical analysis results, has been therefore investigated by EDF, and the first results obtained have been interpreted by IRSN, with the view to linking the results provided by the mathematical analysis to physical properties and processes occurring during irradiation of graphite components. It was found out that results are promising, in the way that they are confirmed by evidences. These elements are the main topic of his paper.

2. POTENTIAL SOURCES OF RADIONUCLIDES IN IRRADIATED GRAPHITE

Nuclear graphite is a synthetic material manufactured from raw materials issuing from petroleum and coal that are natural products full of numerous impurities. Although subjected to thorough purification steps during the manufacturing process, some impurities remain at trace level in the nuclear graphite [1]. As will be shown, the radioactivity of the graphite in UNGG reactors comes almost exclusively from the activation under neutron flux of these impurities and of the carbon constituting the graphite. The other radionuclides are naturally occurring radioactive elements such as ^{40}K and the various isotopes of natural uranium impurities.

In the context of preliminary safety studies, it has been chosen to arbitrarily focus this paper on three radionuclides considered to be representative of various phenomena that may occur in the reactor or considered to be significant for the management of graphite waste. They are the following:

- ^3H (tritium) is in terms of activity level a major radionuclide in irradiated graphite from UNGG reactors. It is a short-lived ($t_{1/2} = 12,33$ years), low energy radionuclide whose potential impact concern mainly its management during the dismantling period and the operating period of a repository. Tritium can be produced through neutron activation of two impurities of the graphite, boron and lithium. The concentrations of lithium and boron impurities in the graphite are equivalent to around 0.1 mg/kg [2]. The tritium produced in UNGG graphite is almost exclusively due to the activation reaction of lithium $^6\text{Li} (n,\alpha) ^3\text{H}$, of which the neutron effective cross section is the highest [3].
- ^{14}C is also in term of activity level a major radionuclide in irradiated graphite. It is a long-lived ($t_{1/2} = 5730$ years), pure β emitter which gives stable ^{14}N by radioactive decay. There are two main ways of forming ^{14}C by neutron activation in graphite: activation of the most abundant isotope of nitrogen (^{14}N) or activation of natural isotope 13 of carbon (^{13}C). The origin of ^{14}C in the graphite from the reactions $^{14}\text{N} (n,p) ^{14}\text{C}$ and $^{13}\text{C} (n,\gamma) ^{14}\text{C}$ highly depends on the nitrogen content in the graphite under operating conditions [2].
- ^{36}Cl is a long-lived radionuclide ($t_{1/2} = 301000$ years). Although minor in terms of activity level in French irradiated graphite, ^{36}Cl is considered in impact studies as the first radionuclide to be released from the repository containment, due to its high mobility. It may be produced in graphite gas-cooled reactors in various ways by direct activation of stable ^{35}Cl and ^{39}K , and also by indirect pathway neutron activation of the stable ^{34}S . With the sulphur and potassium impurity contents in nuclear graphite, it appears that the reaction $^{35}\text{Cl} (n,\gamma) ^{36}\text{Cl}$ is by far the predominant reaction for the formation of ^{36}Cl in graphite of a UNGG reactor [4].

3. THE ISSUE OF RADIONUCLIDE MEASUREMENT DISCREPANCIES

The easiest way to assess the radionuclide inventory of the irradiated graphite should proceed by interpreting radiochemical measurements on irradiated graphite sampled from the pile of the reactors. But in the particular case of irradiated graphite of nuclear purity, high discrepancies have been observed on radionuclide measurements, and particularly for radionuclide whose precursors are present at trace level (two or three orders of magnitude as noticeable in fig. 3)

For EDF reactors, according to the dimensions and geometry of the piles, a set of 20–30 irradiated graphite samples were analysed mostly by radiochemistry on the 200 cores (samples) taken on average per reactor pile. This huge variability observed at the scale of a pile correlates (Bugey 1 data):

- neither with the variation in the neutron flux according the vertical distribution, which is less than one order of magnitude, as shown in fig.1 (x axis height of the pile in cm, y axis in arbitrary units),
- nor with the other macroscopic operational parameters of the reactor such as the temperature which varies at full power approximately linearly from 280 to 530 °C between the top and the bottom of the pile.

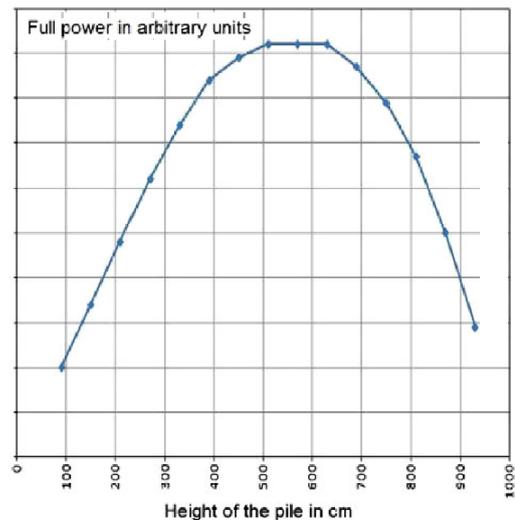


Figure 1: Shape of the thermal power correlated to the neutron flux into a fuel channel of the Bugey 1 reactor with x axis height of the pile in cm and y axis full power in arbitrary units

This observation is also seen for other radionuclides and in other UNGG reactors. It has nothing to do with the quality of sampling, nor with the quality of the analysis method.

The fundamental physical phenomenon that explains the issue of the discrepancy of the analyses is directly linked to the high purity inducing an almost paradoxical and very specific heterogeneity of the nuclear graphite. Very pure nuclear graphite is a well-known polycrystalline material [1] that exhibits a huge heterogeneity from a structural point of view at micro and nanoscale. SIMS characterizations performed on some precursors of radionuclides such as ^{35}Cl also evidence a huge heterogeneity from a chemical point of view. For example, micrometric sized clusters of ^{35}Cl are observed [5]. Actually nuclear graphite cannot be considered from an analytical point of view like any other common homogeneous material (liquid solution, usual steel...) where impurities may exhibit a continuous spatial concentration, but as a finely divided material to which the geostatistical concept of the “nugget effect” can be applied. It concerns a regionalized random function for which the arbitrary closeness of points corresponds nevertheless to a high variance.

These observations demonstrate that it is impossible to get representative and reproducible measurements to the scale of an entire pile for radionuclides and impurities at trace level. Therefore, for establishing the radionuclide inventory of the irradiated graphite, an approach based on a statistical tool through the calculation of a mean of several measurements is a necessity.

4. THE IDENTIFICATION CALCULATION - MEASUREMENT METHOD

The easiest way to assess the radionuclide inventory of the irradiated graphite should proceed by interpreting radiochemical measurements on irradiated graphite sampled

The method of radionuclide inventory assessment by identification calculation-measurement described below is specifically designed for disposal sizing purpose. It consists in using the following process:

- First step: "3D" map computation of the flux density of neutrons (with 315 intervals for neutron energy) based on the geometry of each pile. It is computed with the TRIPOLI calculation code devoted to the transmission of particles (neutrons) by solving the Boltzmann equations and coupled with international nuclear databases.
- Second step: from this flux map and incorporating the history of reactor operation to reconstruct a global inventory of the radioactivity produced by this flux throughout the geometry of the reactor pile; the inventory is then created by incorporating the impurity levels, which are adjusted to their explanatory values (Fig. 2), from the result of the activation calculations (C) with the available measurements (M) of the corresponding radionuclides. These activation calculations are performed by using the DARWIN-PEPIN code which integrates all the phenomena leading to radionuclide production (activation, fission, radioactive decay, etc.) by solving the Bateman equations. The adjustment process for the impurities explanatory values is iterative toward the minimization of the quadratic function:

$$\sum_i \mu_i^2 = \sum_i \left(\frac{1}{N_i} \sum_{j=1}^{j=N_i} \ln \frac{C_{ij}}{M_{ij}} \right)^2$$

where N_i is the number available measurement activity of each i radionuclide (logarithm is used here to let low measurement values participate to the adjustment process).

- In a third step: to calculate a confidence interval taking into account that each measured radionuclide is characterized by a specific standard deviation that is dependent on the number of measurement points available; The standard deviation, which is individual to each measured radionuclide, is used to calculate a confidence interval for its mean calculated value. For an overall determination of the inventory, we consider the upper value of the confidence interval (which corresponds to a 2.5 % risk of under-evaluating the result) of the ratio with respect to the ^{60}Co γ -tracer, in order to remain consistent with the choices usually made in waste management practice because of the well-known ratio robustness.
- In a fourth step, in order to determine the value of activity to be declared for each radionuclide, the upper value of the confidence interval of the ^{60}Co γ -tracer was considered, which thus corresponds to a specific activity to which is added a 2.5 % risk of under evaluation margin, and this upper value was multiplied by the upper value of the ratio previously calculated for the radionuclide concerned.

The relevance of the method for inventory calculation by adjustment calculation-measurement is based upon the availability of a sufficient number of measurements of the wanted radionuclides. This data is processed using the Central Limit Theorem (CLT), employed in order to determine the uncertainty in the activity (which follows a Gaussian probability distribution function by application of the CLT).

Since the variance of a mean is obtained by dividing the variance of the population of measurement points by the number of points, then the larger the number of measurement points, and the smaller the confidence interval on the mean value of the activity of a given radionuclide. This is used to directly obtain the uncertainty calculated from:

- statistical measurement data and the associated adjusted calculations
- number of points used
- under-assessment risk selected (2.5% hereafter)

In practice, for each reactor, EDF has arranged for the analysis of some 30 radionuclides on some 30 samples of graphite taken from the reactor. It is from an order of magnitude of about 30 points that the number of points can be seen as always being sufficient. The withdrawal of any of them does not significantly change either the estimate of the mean or its confidence interval. On the other hand, below 15 points, the calculation that employs the Student law introduces a penalty in terms of increasing the size of the confidence interval.

Step 1 and 2, which are the heart of the proposed method, are schematically described in fig. 2. It is seen as *reverse* method in the sense that the radiological measurement results are some inputs.

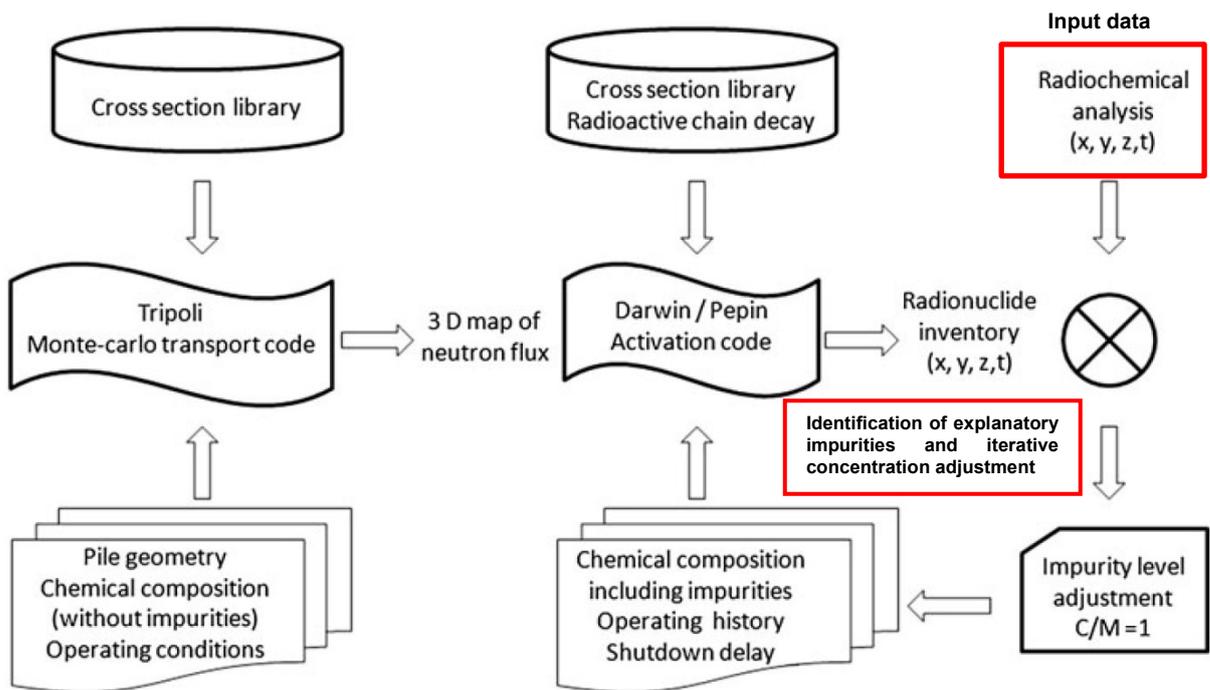


Figure 2: Simplified description of step 1 and step 2 principles for calculating the radionuclide inventory of the piles in the EDF reactors by identification method

4. RESULTS AND DISCUSSION

- *Radiological inventory, fluctuation regularisation, and cross section correlated spatial distribution*

Figure 3 shows the axial distribution of activity weight concentration of ^{36}Cl , ^{14}C and ^3H in Bugey 1 reactor. These activities are the final ones, calculated by activation of the explanatory impurities whose concentration comes from the optimisation process. They are calculated in several radial channels of the pile (C2J6, C1K7...), where measurements were done.

It is striking to see a first that the strong fluctuations in the measurements of these three radionuclides are regularised by the identification-calculation method, with a continuous profile that matches the parabolic neutron flux profile (clearly visible for ^{14}C).


Moreover, if these profiles are regarded through the (thermal) neutron capture cross section (σ_{capt}) of the explanatory impurities, the results become very physical having in mind that:

- σ_{capt} of the $^{13}\text{C} (n, \gamma) ^{14}\text{C}$ reaction is 10^{-3} barn
- σ_{capt} of the $^{35}\text{Cl} (n, \gamma) ^{36}\text{Cl}$ reaction is 43 barns
- σ_{capt} of the $^6\text{Li} (n, \alpha) ^3\text{H}$ reaction is 940 barns

The flat profile of tritium obtained by the proposed method is therefore not surprising: with such a high neutron capture cross section of the ^6Li impurity, the tritium can reach a saturation value, and it is therefore probable that all de ^6Li content has been activated, before the reactor final shutdown, leading to a loss of correlation between the axial distribution of the tritium concentration and the neutron flux. In the contrary to most shaped parabolic profile is found for ^{14}C axial distribution, whose ^{13}C explanatory impurity has a low neutron capture cross section, leading to a strong correlation with the neutron flux.

- *Explanatory impurities and activation scheme*

Beside the results in terms of activity, an output of the method is the relation between activated impurities and radionuclides, and the global activation scheme of the pile. These results of the method are dependent of the method itself. If the nature of the impurities contributing to the formation of a radionuclide can be determined by individual activation calculations, the contributions of these impurities may be affected by the optimisation process or some user choices. For instance, for the present results (Bugey 1) the activation schemes of the three radionuclides presented here are:

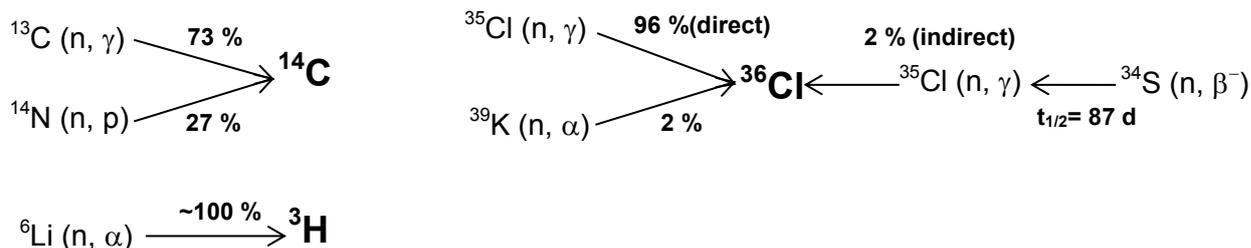

More generally, 144 i-radionuclides are found by the activation of 52 k-impurities through the proposed method. Therefore an output result of the method is the activation matrix M whose terms m_{ki} represent the contributions of the k impurities to i radionuclides at the scale of the whole pile. This activation matrix M is a key result to compare from a pile to another to assess the physical robustness of the method, a comparison work that is planned as a next step.

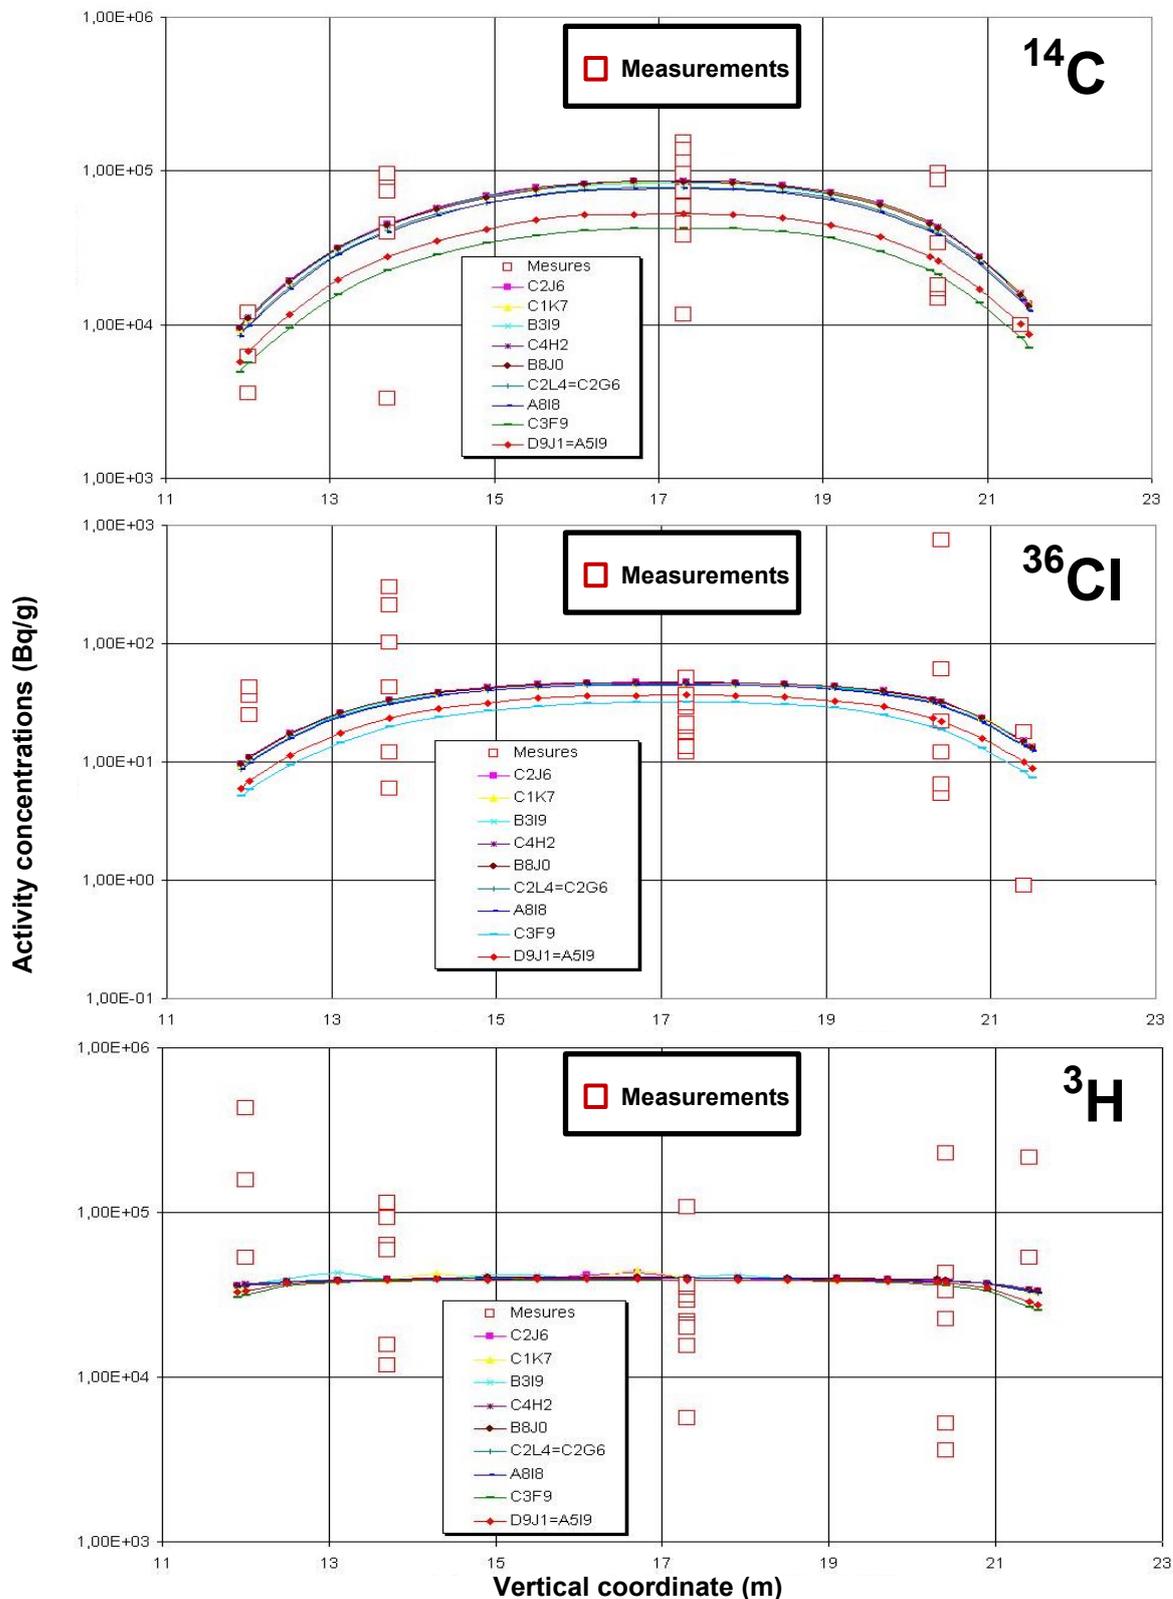


Figure 3: Activity concentration profiles calculated by the proposed method. y axis are Bq/g of ^{14}C , ^{36}Cl and ^3H versus x axis which is vertical coordinate of the Bugey 1 graphite pile with squares representing sample measurements, compared to average calculated curves for the 11 corresponding sampled channels. The more or less parabolic shapes of the calculated profiles are fully explained by the neutron capture cross section of the explanatory impurities (^{13}C , ^{35}Cl and ^6Li)

5. CONCLUSION AND FURTHER WORK

About 17,000 tons of irradiated graphite waste will be produced from the decommissioning of the six French gas-cooled nuclear reactors. Determining their radionuclide content is important for both safety reasons and in order to determine the best practice to manage them. It is not possible to assess the radionuclide inventory by using a conventional activation calculation method alone as for a well-known simple activation of a metallic alloy. But, another way to assess the radionuclide inventory of the irradiated graphite relies on statistically interpreting the radiochemical measurement population of irradiated graphite sampled from the pile of the reactors. This is particularly important with precursors at trace level.

As shown through sampling and measuring campaigns on EDF UNGG graphite piles, radionuclide measurements may exhibit a wide discrepancy. Starting from this very specific fact, EDF-CIDEN has developed a method of 3D geographical reconstitution of the inventory of the nuclear piles based on an activation calculation adjusting the mean value of the several measurements available with the mean value of the calculation corresponding to the measurements (same position and same time). By using an averaging approach to the measurements, and not an approach based on the maximum measurement, the measured data is then made truly representative. The calculation of impurity contents from the measurements is performed on samples by reverse activation calculation. A particularly noteworthy result found by IRSN when expertizing this method is that the calculated activity concentration profiles are fully explainable, regarding the neutron capture cross section. The method seems therefore promising to assess the radiological inventories of all the radioactive nuclear graphite coming from UNGG reactors in France. A next step of validation is to apply this method to every pile, and compare the activation matrix from a pile to another. They are expected to be very similar, ensuring that the results given by the method are not dependant on the considered reactor.

REFERENCES

- [1] Nightingale RE (1962) *Nuclear graphite* Academic press, New York
- [2] Bonal JP, Bresard I, Parraud S (2002) *Caractérisation du graphite des réacteurs de la filière UNGG*, Matériaux 1–5
- [3] *Chart of radionuclide* <http://www.nndc.bnl.gov/chart/chartNuc.jsp>, Accessed 10 Jan 2013
- [4] Clayton AM, Harper A, Wheatley CJ (1997) *Behaviour of chlorine in nuclear graphite*, AEA technology technical report for NIREX T/REP/20121/P/04
- [5] Vaudey CE (2010) *Study of the effects of temperature and radiolysis on chlorine distribution in nuclear graphite*. PhD thesis, University Claude Bernard Lyon 1